



Washer, Electrical Equipment Bond


WEEB

INSTALLATION INSTRUCTIONS


For ERCAM HHL12 Dual-Axis Solar Tracker System Only

Burndy LLC recommends that the sufficient details of the installation be submitted to the AHJ for approval before any work is started.

NOTICE	
	<p>PLEASE READ CAREFULLY BEFORE INSTALLING</p>

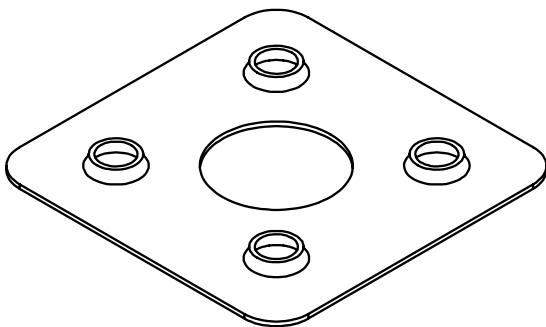

WEEB-UIR

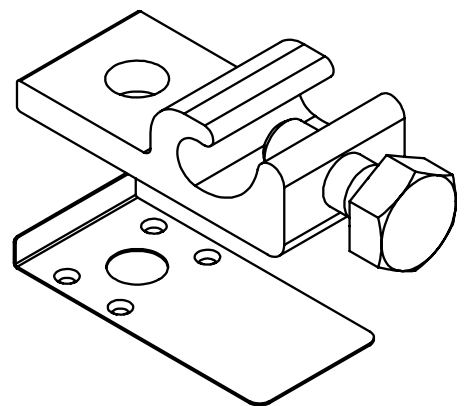

WEEB-LUG-6.7



Products are tested to UL 467, CAN/CSA-C22.2 No. 41 US/ Canadian standards for safety grounding and bonding equipment.




Intertek
4004188



WEEB COMPATIBILITY

The WEEB family of products can be used to bond anodized aluminum, galvanized steel, steel and other electrically conductive metal structures. All installations shall be in accordance with NEC requirements in the USA and with CSA C22.1 in Canada. The WEEBs are for use with modules that have a maximum fuse rating of less than 25A.


Certain module frames do not have enough structural strength to withstand the force required to embed a WEEB. These frames will deform and therefore not allow sufficient penetration of the WEEB teeth. The general requirements for minimum module frame thickness of "boxed" type module frames are illustrated below. For more information regarding module compatibility, please see the technical documents section of our website.

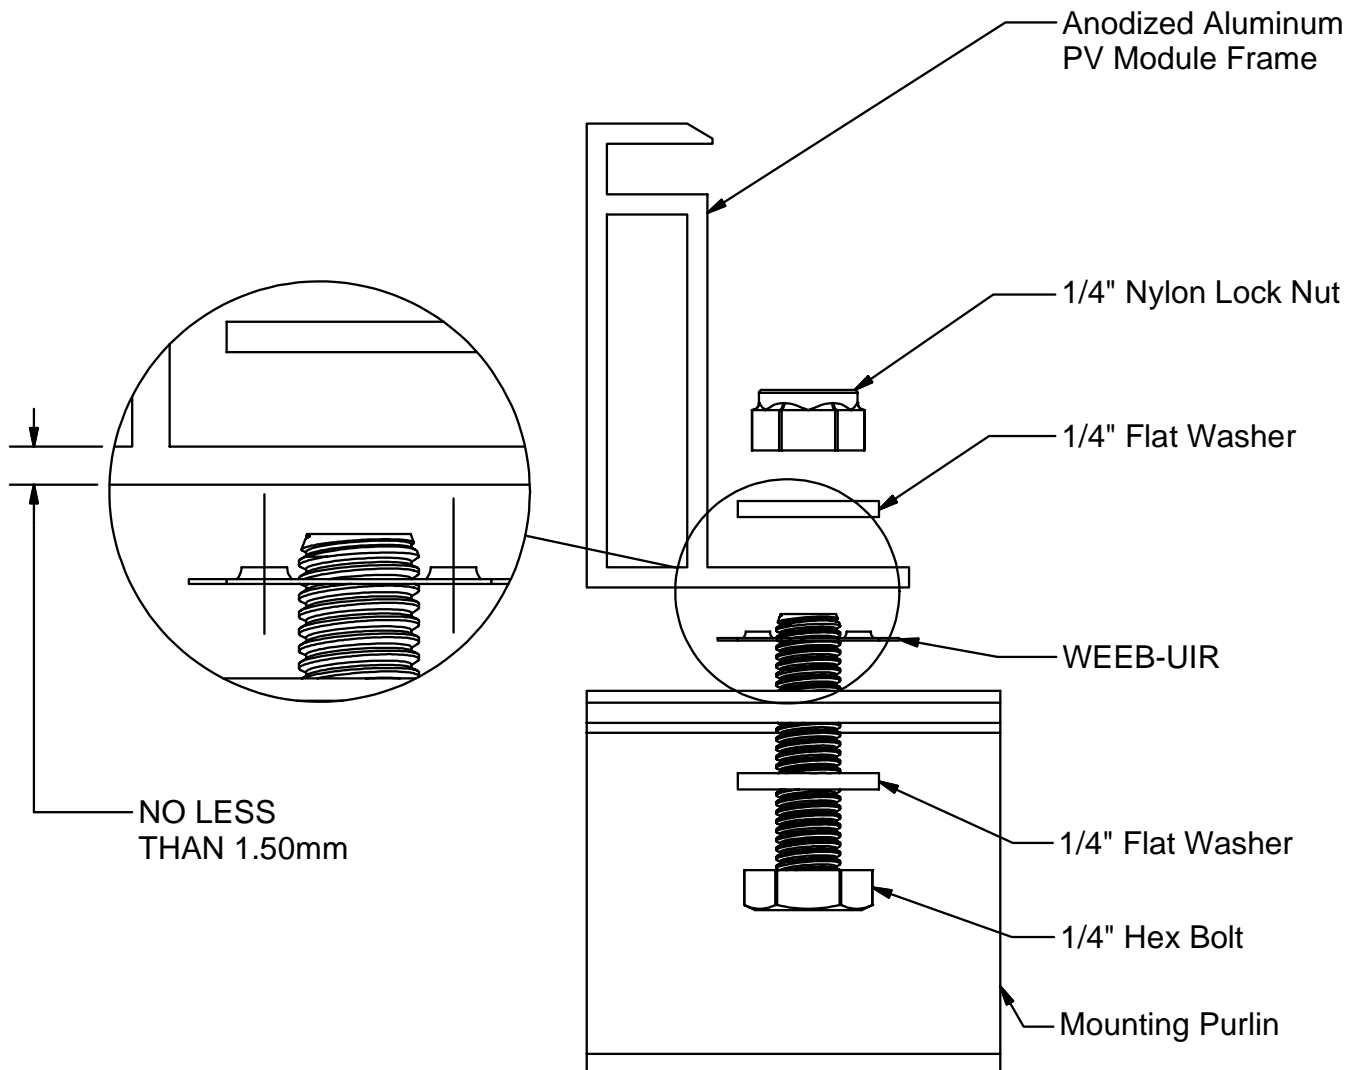


Note:

Inspect each module frame used with a WEEB to ensure that the bottom mounting face of the frame is flat, and that there are no hindrances to embedding WEEB teeth. Do not use a module with a frame that prevents the WEEB teeth from embedding fully.


SYSTEM OVERVIEW

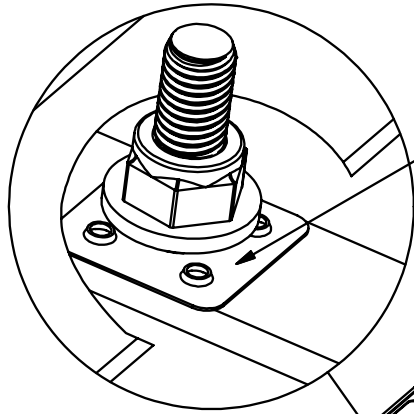

Use WEEB-UIR to bond solar modules to module mounting purlin and torque fasteners to 7ft-lb / 9.5N-m using Penetrox-A on threads.

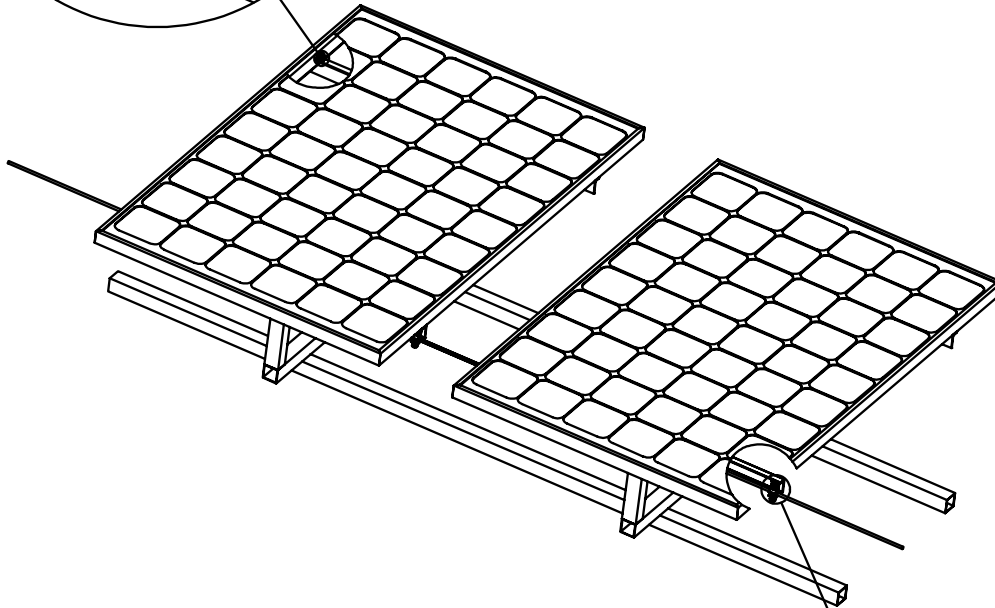

Use one WEEB-LUG-6.7 assembly per purlin to connect system to equipment ground conductor and torque fasteners to 10ft-lb / 13.5N-m using Penetrox-A on threads.

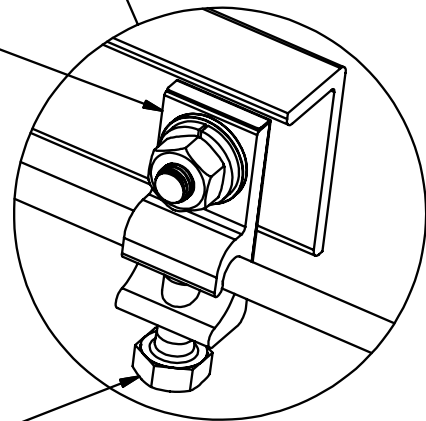


Lay in equipment ground conductor and torque bolt to 7ft-lb / 10N-m

Important notes:

1. Use general purpose anti-seize compound on fastener threads when installing WEEBs.
2. The NEC section 690.43 states “Exposed non-current carrying metal parts of module frames, equipment, and conductor enclosures shall be grounded in accordance with 250.134 or 250.136(A) regardless of voltage”.
3. WEEBs are intended for **SINGLE USE ONLY**. Functionality will not be guaranteed if reused.

WEEB-UIR LAYOUT

EVEN NUMBER OF MODULES IN ROW

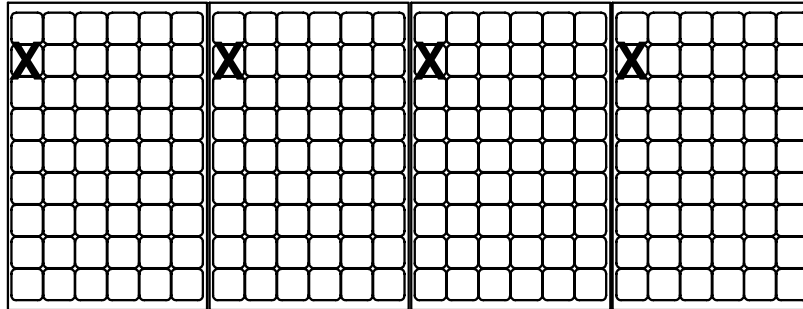


X DENOTES PLACES TO INSTALL WEEB-UIR

$$C \times R = 4 \times 1$$

$$\text{WEEB-UIR NEEDED} = C \times R = 4 \times 1 = 4$$

ODD NUMBER OF MODULES IN ROW

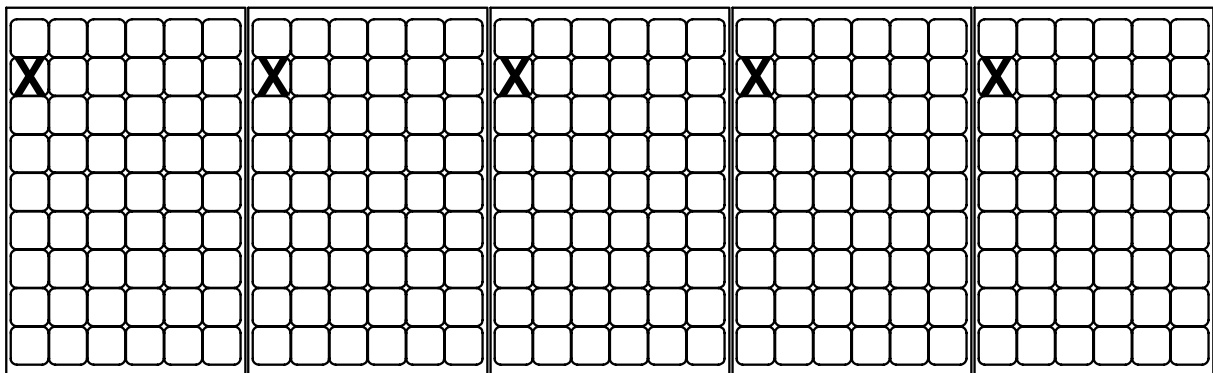


X DENOTES PLACES TO INSTALL WEEB-UIR


$$C \times R = 5 \times 1$$

$$\text{WEEB-UIR NEEDED} = C \times R = 5 \times 1 = 5$$

WEEB-LUG-6.7 LOCATIONS

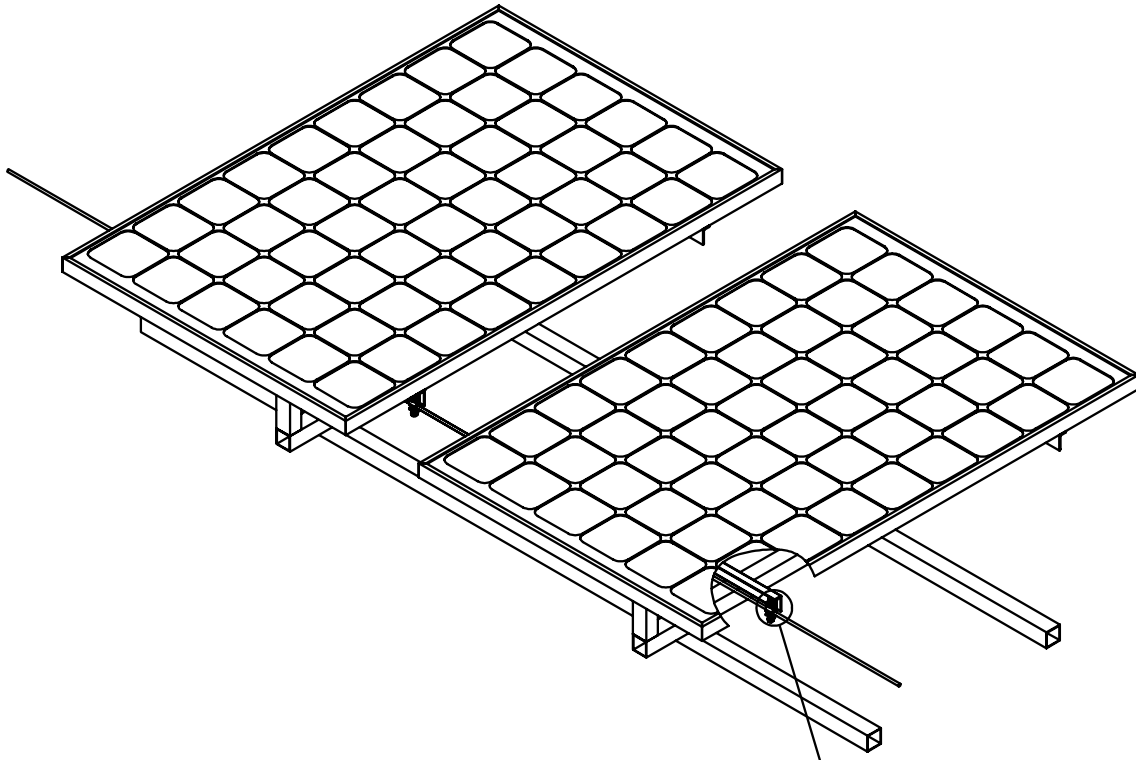

Install one WEEB-LUG-6.7 assembly
on one purlin of each Module

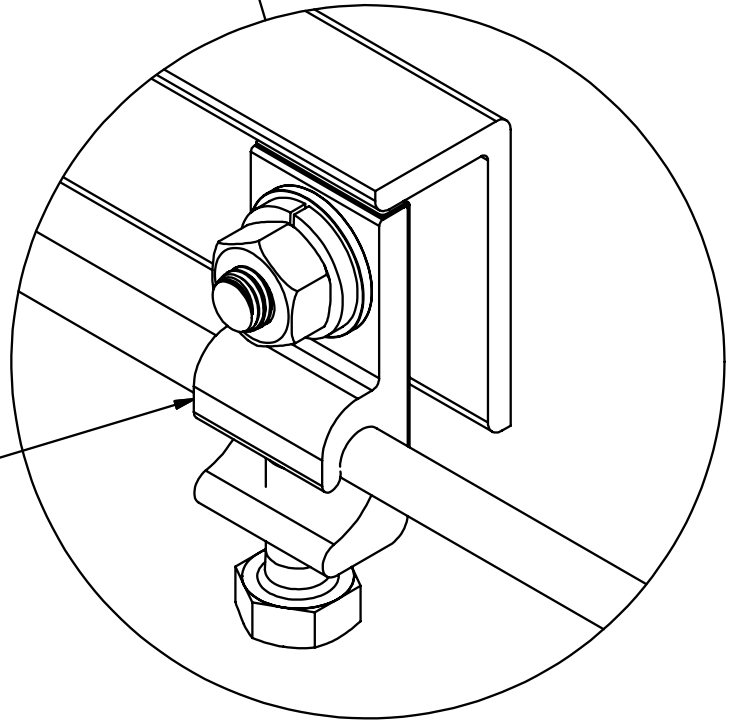

Customer Service Department
7 Aviation Park Drive
Londonderry, NH 03053
1-800-346-4175
1-603-647-5299 (International)