
Cable Gland Assembly Instructions ICG 653 UNIV



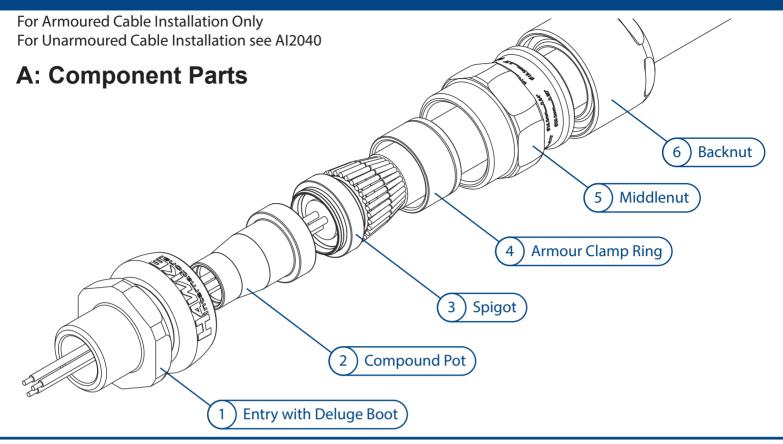

B: Cable Preparation


Slide shroud (if included), backnut @, middlenut @ and armour clamp ring @ onto cable.

Confirm orientation of armour clamp ring is correct (see table below).

Cut cable length, strip outer sheath and cut armour to lengths as shown in table below.

For preparation of Drain Wires see separate Al2028.

If an inner sheath is not present and using Express Resin, use electrical tape wrapped around the base of the cores to create a suitable sealing surface.

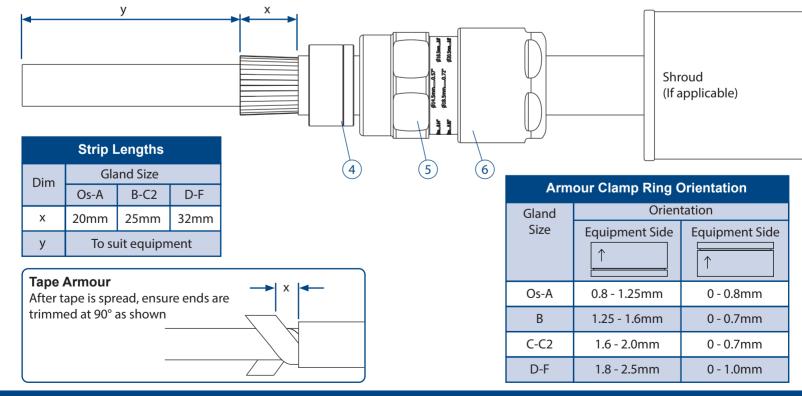








C: Installing Cable Gland

STEP 1: Fit Armour To Spigot


Check cut end of cable inner sheath for any sharp edges ②. If necessary clean up with a knife or apply electrical tape to smooth corners. Slide spigot ③ over cable taking care not to damage rubber resin dam.

Push armour/braid up to spigot shoulder.

Slide clamping ring @ up to the armour/braid by hand.



STEP 2: Prepare to Clamp Armour/Braid

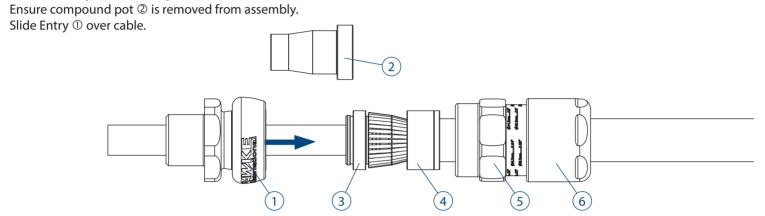


STEP 3: Clamp Armour/Braid

Slide middlenut ⑤ up to entry and hand tighten.

Grip the entry ① with a spanner/wrench.

Use a second spanner/wrench to tighten half to three quarters of a turn.

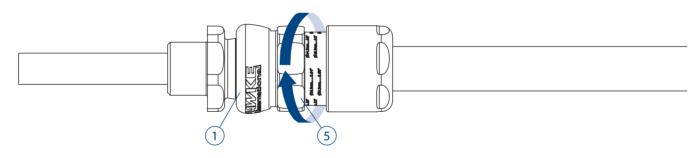


STEP 4: Inspect Armour/Braid

Unscrew the middlenut $\$. The armour clamp ring $\$ should now be locked in place.

Visually inspect that the armour/braid has been successfully clamped between the spigot ③ and the armour clamp ring ④.

If clamping is not satisfactory, repeat step 3.

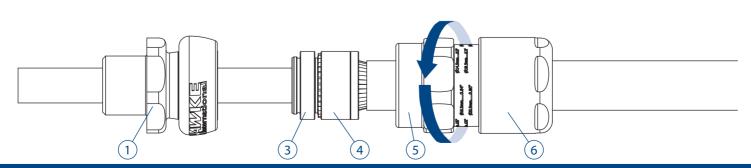

Images for illustration purposes only Al 2001 - Issue I / Page 2 of 4 Product supplied may differ from that shown


20 25

STEP 5: Strip Inner sheath to expose cores

Strip inner sheath back to between flush and 3mm from end of spigot 3, taking care not to damage resin dam.

Ensure the inner sheath protrudes through the resin dam.

Fit the pot ② and check that the inner sheath is below the height of the pot shoulder as shown below.

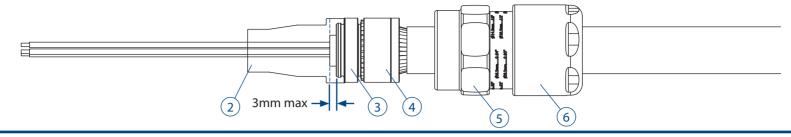

STEP 6: Pot gland with compound

Gland assembly is now ready for compound. Refer to the correct instructions depending on compound type. These instructions are supplied with the compound.

HAWKESEAL

2-Part Epoxy Putty See Al 2034




2-Part Pouring Epoxy Resin See Al 2035

STEP 7: Fit to Enclosure

Now potting the gland is complete, use a wrench to fit entry ① into enclosure. If required, use the appropriate IP washer ⑧.

Slide cable through entry ① until pot ② is seated in the entry.

Hand tighten the middlenut ⑤ to entry and add 1/5 - 1/4 turn with a wrench.

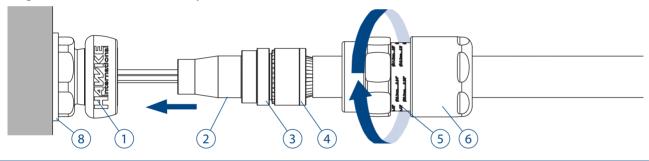


STEP 8: Install Backnut

Tighten the backnut © until a seal is formed around the cable.


Use a wrench/spanner to grip the middlenut ⑤.

While preventing the middlenut ⑤ turning, use a second wrench to apply one further full turn to the backnut ⑥.

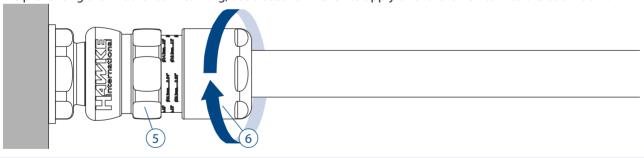

STEP 9: Inspect Backnut

Use the middlenut ⑤ guide as an indication that the backnut ⑥ is in the correct position to suit cable diameter. Slide shroud over cable gland if applicable.

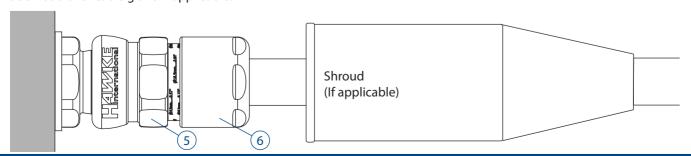

AI 2001 - Issue I / Page 3 of 4

Images for illustration purposes only roduct supplied may differ from that shown

60 65 70 75 80 Diameter Scale (mm)

Technical Information ICG 653 UNIV



TECHNICAL DATA

Cable Gland Type: ICG 653 UNIV

Equipment Type: Group II Barrier Cable Glands Ingress Protection: IP66, IP67, IP68*, IP69, NEMA 4X

> *30m for 7 days to EN60529 with thread sealant, see AI464 for sealant application instructions; 10m for 24hrs no thread sealant, Os-C size only

Operating Temp: -60°C to +80°C

INSTALLATION NOTES

- 1. All cable glands must be installed by a suitably trained and competent individual
- 2. Entry threads are in accordance with Metric BS3643 or NPT B1.20.1
- 3. Installer must check material compatability with enclosure and environment.
- 4. To maintain IP ratings, Hawke certified sealing washer or other approved sealing method must be used.
- 5. Sealing face surface must be smooth and free from damage
- 6. Wall thicknesses depended on thread length or retention type (locknut etc). Exd must maintain the requirements of IEC/EN 60079-1
- 7. All entries must be installed perpendicular to the mounting surface.
- 8. Cable gland may be used with unarmoured cable. If fitting to unarmoured cable, see Al2040 for installation instructions.

TORQUE VALUES

All torque values below were generated on metallic mandrels. For cable, it is recommended that the assembly instructions are followed.

Torque Figures N/m										
Gland Size	Os	0	Α	В	С	C2	D	Е	F	
Middlenut Torque	6	6	8	8	10	15	15	28	35	
Backnut Torque	12	12	20	30	35	45	56	60	75	

ACCESSORIES

Hawke offer the following accessories to enable correct sealing and ground of cable gland.

Shroud: For additional corrosion protection Locknut: To secure gland into position Sealing Washer: For additional ingress protection Earth Tag: For external bonding point

Serrated Washer: To prevent vibration loosening locknuts

SCHEDULE OF LIMITATIONS

- 1. When the gland is used for increased safety, the entry thread shall be suitably sealed to maintain the ingress protection rating of the associated
- 2. Compound cross section must be minimum 20% of total area over a depth of 20mm

CERTIFICATION DETAILS

ATEX/IECEx/UKEx

Ex db IIC Gb / Ex eb IIC Gb / Ex nR IIC Gc / Ex tb IIIC Db

ATEX: CMI 18ATEX1268X

IECEx: CML18.0131X UKEx: CML21UKEX1132X

NEC/CEC

Class I Div 1 ABCD, Class II Div 2 EFG and Class III CLI Zn1 (A)Ex db eb IIC Gb Zn21 (A)Ex tb IIIC Db CSA: 1024328

Additional Approvals

EAC: No EA3C RU C-GB.HA91.B.00264/21 KCs: 17-KA4BO-0159X to 0167X

CNEX: CNEx17 2858X

Inmetro: IEx 14.0272X

PESO: P450038

CABLE GLAND SELECTION TABLE													
	Entry Thread Size												
Size Ref.			Inner Sheath	Cores			Outer Sheath		Steel Wire Armour/ Tape/Braid		Max	Hexagon Dimensions	
	Metric	NPT	Max. Dia	Max. Over Cores	ATEX Max. No. of Cores	Max .No. Fibre Optic	Min.	Max.	Orientation 1	Orientation 2	Length	Across Flats	Across Corners
Os	M20	1/2"	8.1	8.0	12	48	5.5	12.0	0.8/1.25	0/0.8	72.5	24.0	26.5
0	M20	1/2"	11.7	8.8	12	48	9.5	16.0	0.8/1.25	0/0.8	72.5	24.0	26.5
Α	M20	1/2" - 3/4"	14.0	10.8	15	72	12.5	20.5	0.8/1.25	0/0.8	76.3	30.0	32.5
В	M25	3/4" - 1"	19.9	15.9	30	144	16.9	26.0	1.25/1.6	0/0.7	81.9	36.0	39.5
С	M32	1" - 1¼"	26.2	21.9	42	-	22.0	33.0	1.6/2.0	0/0.7	89.0	46.0	50.5
C2	M40	11/4" - 11/2"	32.3	26.7	60	-	28.0	41.0	1.6/2.0	0/0.7	96.4	55.0	60.6
D	M50	2"	44.2	37.7	80	-	36.0	52.6	1.8/2.5	0/1.0	122.5	65.0	70.8
Е	M63	2½"	56.0	49.0	100	-	46.0	65.3	1.8/2.5	0/1.0	118.6	80.0	88.0
F	M75	3"	68.0	59.8	120	-	57.0	78.0	1.8/2.5	0/1.0	126.3	95.0	104.0

EU Declaration of Conformity in accordance with European Directive 2014/34/EU and UK Statutory Instrument 2016/1107

Manufacturer: Hawke International, Oxford Street West, Ashton-under-Lyne, OL7 0NA, United Kingdom

Provisions of the Directive fulfilled by the Equipment: Group II Category 2GD Ex db eb IIC Gb, Ex nR IIC Gc, Ex tb IIIC Db – IP66 67

Harmonized Standards used: EN 60079-0:2018, EN60079-1:2014, EN60079-7:2015+A1:2018, EN60079-15:2019, EN60079-31:2014

Notified Body for EU-Type Examination: CML B.V. 2776 Amsterdam, NLD EU-type Examination Certificate: CML18ATEX1268X, CML19ATEX4507X (Ex nR) Notified Body for production: 0598

Approved Body for UK-Type Examination: CML B.V. 2503 Chester, UK UK-type Examination Certificate: CML21UKEX1132X, CML21UKEX4133X (Ex nR) Approved Body for production: 1180

On behalf of the above named company, I declare that on the date the equipment, accompanied by this declaration, is placed on the market the equipment conforms with all technical and regulatory requirements of the above listed directives.

