
Cable Gland Assembly Instructions 653 UNIV




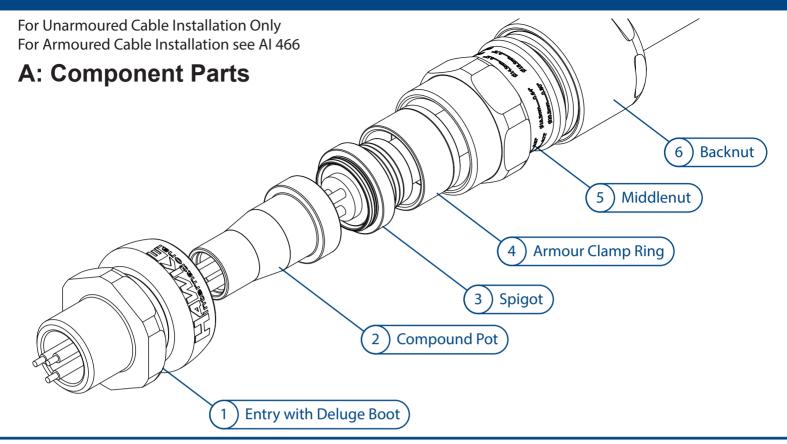

B: Cable Preparation

Slide shroud (if included), backnut @, middlenut @ and armour clamp ring @ onto cable. Orientation of armour clamping ring is unimportant. Cut cable length to suit equipment.

For preparation of Drain Wires see separate Al2028.

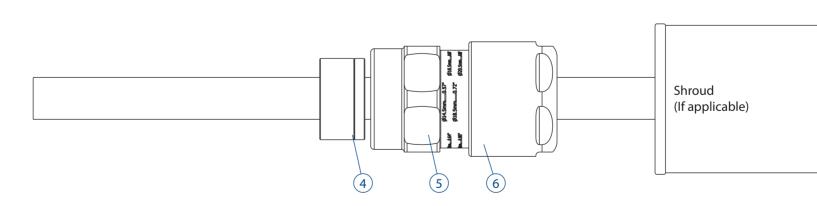




C: Installing Cable Gland


STEP 1: Slide Spigot Over Cable

Check cut end of cable inner sheath for any sharp edges ②. If necessary clean up with a knife or apply electrical tape to smooth corners. Slide spigot ③ over cable taking care not to damage rubber resin dam.

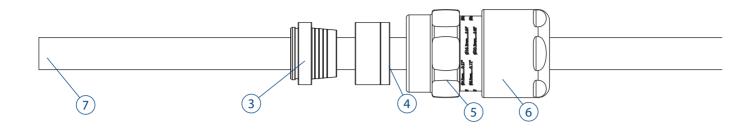


STEP 2: Strip Cable To Expose Cores

Strip core length to suit installation. Position spigot ③ as shown below.

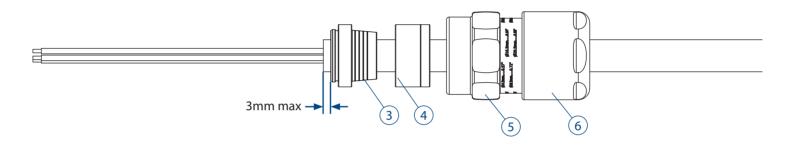


STEP 3: Fit Compound Pot

Clip pot over the spigot ③.

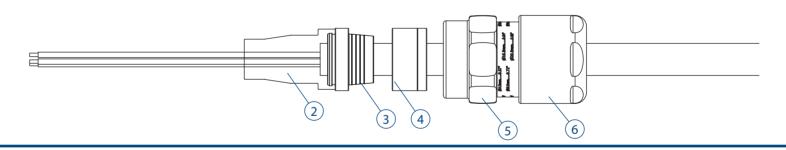

STEP 4: Support Spigot With Middlenut and Backnut

Slide middlenut \$ up to spigot \$, so that the armour clamping ring \$ is seated between spigot \$ and middlenut \$. Hand tighten the backnut \$ so the assembly cannot slide down the cable.

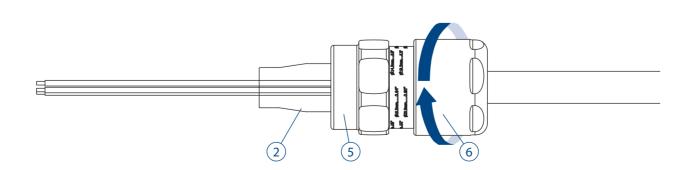

Images for illustration purposes only
Al 2041 - Issue G / Page 2 of 4
Product supplied may differ from that shown

5 10 15 20 25 30 35 40 45

STEP 5: Pot gland with compound

Gland assembly is now ready for compound. Refer to the correct instructions depending on compound type. These instructions are supplied with the compound.





2-Part Epoxy Putty See Al 2034 2-Part Pouring Epoxy Resin See Al 2035


STEP 7: Fit to Enclosure

Now potting the gland is complete, first loosen the backnut ⑥.

Use a wrench to fit entry \odot into enclosure. If required, use the appropriate IP washer \otimes .

Slide cable through entry ① until pot ② is seated in the entry.

Hand tighten the middlenut ⑤ to entry and add 1/5 - 1/4 turn with a wrench.

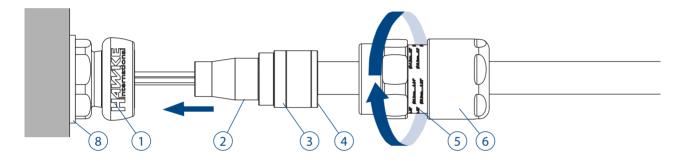


STEP 8: Install Backnut

Tighten the backnut © until a seal is formed around the cable.

Use a wrench/spanner to grip the middlenut ⑤.

While preventing the middlenut ⑤ turning, use a second wrench to apply one further full turn to the backnut ⑥.

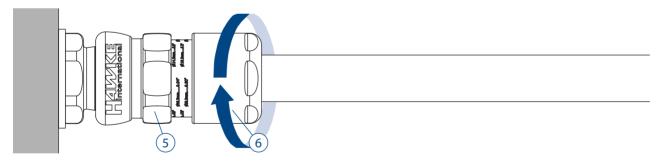


STEP 9: Inspect Backnut

Use the middlenut ⑤ guide as an indication that the backnut ⑥ is in the correct position to suit cable diameter.

A diameter scale below is provided to assist in this process.

Slide shroud over cable gland if applicable.

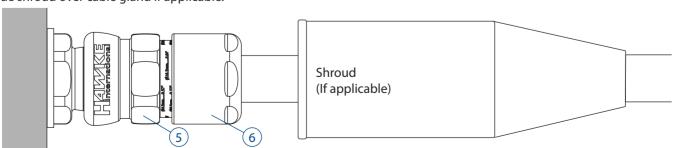

Images for illustration purposes only
Al 2041 - Issue G / Page 3 of 4

Product supplied may differ from that shown

50 55 60 65 70 75 80 Diameter Scale (mm)

Technical Information 653 UNIV



TECHNICAL DATA

Cable Gland Type: **653 UNIV**

Equipment Type: Mining Cable Glands

Ingress Protection: IP66, IP67, IP68*, IP69, NEMA 4X

*30m for 7 days with thread sealant;

10m for 24hrs no thread sealant, Os-C size only

Operating Temp: -60°C to +80°C

CERTIFICATION DETAILS

Group I Category IM2 Ex eb I, Ex db I

ATEX: CML19ATEX1169X IFCFx: CMI 19 0047X UKEX: CML 21UKEX1162X

EAC: No EA3C RU-C-GB.HA91.B.00264/21

INSTALLATION NOTES

- 1. All cable glands must be installed by a suitably trained and competent
- 2. Entry threads are in accordance with Metric BS3643 or NPT B1.20.1
- 3. Installer must check material compatability with enclosure and environment
- 4. To maintain IP66/IP67/IP69, Hawke certified sealing washer or other approved sealing method must be used.
- 5. Sealing face surface must be smooth and free from damage
- 6. Wall thicknesses depended on thread length or retention type (locknut etc). Exd must maintain the requirements of IEC/EN 60079-1
- 7. All entries must be installed perpendicular to the mounting surface

ACCESSORIES

Hawke offer the following accessories to enable correct sealing and ground of cable gland.

Shroud: For additional corrosion protection Locknut: To secure gland into position Sealing Washer: For additional ingress protection Earth Tag: For external bonding point

Serrated Washer: To prevent vibration loosening locknuts

SCHEDULE OF LIMITATIONS

- 1. When the gland is used for increased safety, the entry thread shall be suitably sealed to maintain the ingress protection rating of the associated enclosure.
- 2. Compound cross section must be minimum 20% of total area over a depth of 20mm

TORQUE VALUES

All torque values below were generated on metallic mandrels. For cable, it is recommended that the assembly instructions are followed.

Torque Figures N/m										
Gland Size	Os	0	Α	В	С	C2	D	Е	F	
Middlenut Torque	6	6	8	8	10	15	15	28	35	
Backnut Torque	12	12	20	30	35	45	56	60	75	

CABLE GLAND SELECTION TABLE											
	Entry Thread Size		Cable Acceptance Details								
Size Ref.			Inner Sheath	Cores			Outer Sheath		Max	Hexagon Dimensions	
	Metric	NPT	Max. Dia	Max. Over Cores	ATEX Max. No. of Cores	Max .No. Fibre Optic	Min.	Max.	Length	Across Flats	Across Corners
Os	M20	1/2"	8.1	8.0	12	48	5.5	12.0	58.4	24.0	26.5
0	M20	1/2"	11.7	8.8	12	48	9.5	16.0	58.4	24.0	26.5
Α	M20	1/2" - 3/4"	14.0	10.8	15	72	12.5	20.5	60.6	30.0	32.5
В	M25	3/4" - 1"	19.9	15.9	30	144	16.9	26.0	67.3	36.0	39.5
С	M32	1" - 11⁄4"	26.2	21.9	42	-	22.0	33.0	73.2	46.0	50.5
C2	M40	11⁄4" - 11⁄2"	32.3	26.7	60	-	28.0	41.0	78.3	55.0	60.6
D	M50	2"	44.2	37.7	80	-	36.0	52.6	97.5	65.0	70.8
Е	M63	2½"	56.0	49.0	100	-	46.0	65.3	93.5	80.0	88.0
F	M75	3"	68.0	59.8	120	-	57.0	78.0	104.5	95.0	104.0

EU Declaration of Conformity in accordance with European Directive 2014/34/EU and UK Statutory Instrument 2016/1107

Manufacturer: Hawke International, Oxford Street West, Ashton-under-Lyne, OL7 0NA, United Kingdom

Equipment: 453/UNIV

Provisions of the Directive fulfilled by the Equipment: Group | Category 1M2 Ex eb | Mb, Ex db | Mb - IP66/IP67 Harmonized Standards used: EN 60079-0:2018, EN60079-1:2014, EN60079-7:2015+A1:2018

Notified Body for EU-Type Examination: CML B.V. 2776 Amsterdam, NLD EU-type Examination Certificate: CML19ATEX1169X Notified Body for production: 0598

Approved Body for UK-Type Examination: CML B.V. 2503 Chester, UK UK-type Examination Certificate: CML21UKEX1162X Approved Body for production: 1180

On behalf of the above named company, I declare that on the date the equipment, accompanied by this declaration, is placed on the market the equipment conforms with all technical and regulatory requirements of the above listed directives.

