

INSTALLATION, OPERATION AND MAINTENANCE INSTRUCTIONS


HDN106 - Emergency Luminaires


Important:

Please read these instructions carefully before installing or maintaining this equipment. Good electrical practices should be followed at all times and this data should be used as a guide only.





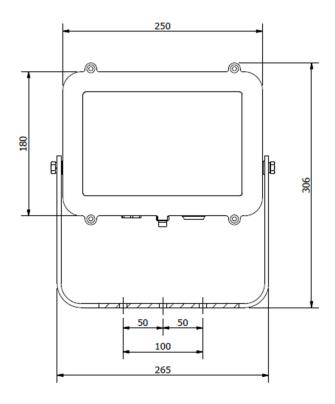

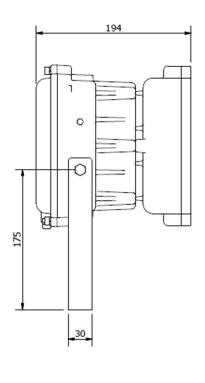

Weight 8kg

Windage - 0.05m²



Type of Protection	N/A				
Protection Standards	EN 60598-1, EN 60598-2-22.				
Area Classification	Industrial (Non-Hazardous)				
Installation	(IEC) EN 60079-14				
Ambient	HDN106				
	100V to 254V 50/60Hz	for use at +55°C ambient see below.			
	-20°≤ Ta ≤+50°C				
Ingress Protection	IP66/67				
Laser safety class	Class 1 LED product				
CE	The CE marking of this product applies to "The Electrical Equipment (Safety) Regulations 2006", "The Electromagnetic Compatibility Regulations 2004", the "Waste Electrical and Electronic Equipment Regulations 2006". This legislation is the equivalent in UK law of EU directives 2014/35/EU, 2014/30/EU, 2012/19/EU respectively.				
UK CA	The UKCA marking of this product applies to "The Electrical Equipment (Safety) Regulations 2016", "The Electromagnetic Compatibility Regulations 2016", the "Waste Electrical and Electronic Equipment Regulations 2012 M Poutney Technical Manager				

The battery powered emergency versions, are suitable for an ambient temperature range of -20°C to +50°C when installed with the terminal cross-link in accordance with the manufacturer's installation instructions, which achieves a 75% output, i.e. 48 illuminated LEDs. The HDN106 is suitable for an ambient temperature range of -20°C to +55°C when the terminal cross-link is not installed, which achieves 35% output.

1.0 Introduction

The Chalmit HDN106 range is a compact light source that uses ultra-bright light emitting diodes to provide light from mains power. The LEDs are maintenance free and can last up to 150,000 hours @ 25°C ambient. They are housed in an impact and corrosion resistant marine grade aluminium enclosure with a toughened glass or polycarbonate lens. The control gear is electronic with regulated lamp output. The LEDs work equally well at very low temperatures as they do at high and produce a product with very low overall power consumption.

Important:

Electrostatic Charging Hazard: Clean only with a damp cloth, when fitted with a polycarbonate lens.

LED White High Power.

Voltage ranges: 100 - 254V 50/60 Hz

Electrical Operating Data @ 100-254V 50Hz	48 x LED HDN106NE	96 x LED HDN106NES	96 x LED HDN106NEE	144 x LED HDN106NSES	144 x LED HDN106NESE	144 x LED HDN106NEEE
Power Watts	62W	105W	122W	149W	165W	184W
Current Amps	0.66 - 0.27A	1.11 - 0.44A	1.3 – 0.51A	1.57 – 0.62A	1.74 – 0.68A	2.0 – 0.77A

For lumen output photometric data can be requested.



Power Factor 0.9 minimum

Over voltage 375V

Looping The looping current rating is 12A. 4mm² terminals are standard.

Storage Luminaires are to be stored in cool dry conditions -40°C to +50°C

preventing ingress of moisture and condensation.

Battery packs in storage should be cycled charged/discharged/charged every 9

months, as per instructions below.

Always disconnect battery plug and socket for storage.

Any specific instructions concerning emergency luminaires must be complied

with.

(Warning: Battery packs not cycled and stored for a year may not be

recoverable)

'IMPORTANT NOTE FOR ALL EMERGENCY UNITS:

Please ensure encapsulated fuse provided in each emergency unit is removed from its packaging and connected between the 2 terminals marked 'BATT +'. Failure to do so will mean luminaire will not operate in emergency mode.'

PAT Testing (Insulation) 500V DC MAX for 1 min

1.0 Installation and Safety

1.1 General

There are no health hazards associated with this product whilst in normal use. However, care should be exercised during the following operations. Installation should be carried out in accordance with the local area code of practice, whichever is appropriate, and fitting of specified insulating material to be adhered to where a specific fire resistance rating is required. In the UK the requirements of the 'Health and Safety at Work Act' must be met.

Handling and electrical work associated with this product to be in accordance with the 'Manual Handling Operations Regulations' and 'Electricity at Work Regulations, 1989'. Your attention is drawn to the paragraphs (i) 'Electrical Supplies', (ii) 'Electrical Fault Finding and Replacement' and (iii) 'Inspection and Maintenance'. The luminaires are class 1 and should be effectively earthed. Certification details on the rating plate must be verified against the application requirements before installation.

The information in this leaflet is correct at the time of publication. The company reserves the right to make specification changes as required.

1.2 Tools

5mm Allen Key (Hex)

Spanners for installing cable glands. Pliers, knife, wire strippers/cutters.

2.0 Electrical Supplies

The standard unit is rated for a nominal 100V-254V AC 50Hz or 60Hz. A maximum voltage variation of +6%/-6% on the nominal is expected. Equipment must not be operated outside of the rated voltage of the control gear. The lamp supply is regulated therefore the light output over the supply range is constant.

3.0 LED Array & Driver

This product is fitted with LEDs that can last up to 150,000 hours @ 25°C ambient. Therefore in many applications replacement of the LED array will be unnecessary. If replacement is required ensure mains supplies are isolated before commencing work. Remove the front cover and then remove the LED array assembly. Care must be taken when disconnecting and reconnecting wiring. If required contact Chalmit Technical.



4.0 Mounting

Luminaires should be installed where access for maintenance is practical and in accordance with any lighting design information provided for the installation.

The fitting is supplied with an eye bolt for a safety line.

NOTE: When mounting a triple unit, the 2 outermost and the centre mounting holes must be used to secure the stirrup in place.

5.0 Cabling and Cable Glands

5.1 Cables

The maximum conductor size is 4mm². Internal earth point is provided in the main terminal block. 300/500V cable ratings are adequate and no special internal construction is necessary. The standard looping cable size is up to 4mm². The selection of cable size must be suitable for the fuse rating. Terminals are supplied with suitability for looping. Where looping is used the maximum current is 12A. Terminals are accessed by removing the front cover and LED array. For Maximum cable temperature rise refer to nameplate..

5.2 Cable Glands

The installer and user must take responsibility for the selection of cables, cable glands and seals. Two tapped cable entries are provided, one with a plug and seal suitable for permanent use, the other with a travelling plug not suitable for use in service. Sealing plugs are similarly rated and a tool must be used for their removal. Cable entries are M20x1.5.

The cable and gland assembly when installed must maintain the ingress protection rating of the luminaire. The cable glands must be suitable for the application. Where brass cable glands are used in a corrosive environment, cadmium or nickel plating should be used.

6.0 Inspection and maintenance

Visual inspection should be carried out at a minimum of 12 monthly intervals and more frequently if conditions are severe.

7.0 Electrical fault finding and replacement

Any fault finding must be done by a competent electrician with the luminaire isolated and, if carried out with the luminaire in place, under a permit to work. Fault finding is by substitution with known good components.

If the battery is to be checked separately, it should be charged using a **constant current charger** at 200/400mA for 30/15 hours for the 7Ah. Discharge measurement is not easy as the current is proportional to the voltage for resistance loads, so it has to be averaged. Discharge the battery at 1 to 2A and multiply current by time. Do not discharge below 1 volt per cell, which is 5V. The capacity should be 75% or more of normal.

8.0 Routine Maintenance

Individual organisations will have their own procedures. What follows are guidelines based on our experience: Check that the LEDs are working.

Check for mechanical damage/corrosion.

Check for loose connections including earthing.

Check for undue accumulations of dust or dirt.

Verification of tightness of fixing, glands, blanking plugs etc. *Torque Values- Stirrup mounting point: 10Nm, Aluminium/Glass Diffuser fixing screws: 4Nm, Polycarbonate Diffuser fixing screws: 1.5 - 2Nm.*

Check for unauthorised modifications.

Check condition of enclosure gasket and fastenings.

Check for any accumulation of moisture.

Periodic inspection of the enclosure seal should be carried out to ensure that the seal is sound.

If the luminaire has been subject to abnormal conditions, for example, severe mechanical impact or chemical spillage, it must be de-energised until it has been inspected by an authorised and competent person. If in doubt, the unit should be returned to Chalmit for examination and, if necessary, replacement.

Before re-assembling, all connections should be checked and any damaged cable replaced.

Examine the batteries for any signs of leakage or corrosion and if this has taken place the battery packs must be replaced. Contact Chalmit sales for details.



9.0 Disposal of Material

The unit is mainly made from incombustible materials. The control gear contains plastic resin and electronic components. All electrical components may give off noxious fumes if incinerated. Take care to render these fumes harmless or avoid inhalation. Any local regulations concerning disposal must be complied with. Any disposal must satisfy the requirements of the <u>WEEE directive [2012/19/EU and Regulations 2012]</u> and therefore must not be treated as commercial waste.

10.0 Battery Disposal

Nickel cadmium batteries are defined as 'controlled waste' under the hazardous waste regulations and the disposer needs to observe a 'duty of care'.

Batteries can be returned to the manufacturers for recycling. They must be stored and transported safely and any necessary pollution control forms completed prior to transportation. Take care to fully discharge batteries before transporting or otherwise ensure that there can be no release of stored energy in transit. For further details refer to our Technical Department.



To comply with the Waste Electrical and Electronic Equipment directive 2012/19/EU and Regulations 2012 the apparatus cannot be classified as commercial waste and as such must be disposed of or recycled in such a manner as to reduce the environmental impact.

Chalmit Lighting is a leading supplier of Hazardous Area lighting products



CHALMIT LIGHTING

PO Box 5575 Glasgow, G52 9AP Scotland



Telephone: +44 (0) 141 882 5555
Fax: +44 (0) 141 883 3704
Email: info@chalmit.com
Web: www.chalmit.com

Registered No: Registered Office:

Cannon Place 78 Cannon Street London EC4N 6AF UK

669157

For technical support, please contact: techsupport@chalmit.com

 $Note: Chalmit\ Lighting\ reserves\ the\ right\ to\ amend\ characteristics\ of\ our\ products\ and\ all\ data\ is\ for\ guidance\ only.$



2	EU/UK-Declaration of conformity							
☆ ☆ ☆ ☆	UE-Déclaration de conformité							
公公公	EU-Konformitätserklärung							
			1					
Manufacturer	Chalmit	Address	388 Hillingto	n Road, Glasgow. G52 4BL Sco	tland UK			
Product	HDN 106 Modul	ar Industrial Floodlight. (Emergency)					
Catalogue		HDN106****						
Area Classification Industrial (Non- Hazardous)								
Ingress Protection IP66/67								
Ambient		HDN106 100V to 254V 50/60Hz20°≤ Ta ≤+50°C						
		or -20°≤ Ta ≤+55°C (see IOM)						
Terms of the direct	ctive:			Standard & Date Certified to	Standards Date Declared to			
Prescription de la	directive:			Standard & date certifiée à	Normes date Déclaré			
Bestimmungen de	er Richtlinie:			Standard & Datum	Standards Datum erklärt			
200mmangen as rushame				Zertifiziert nach				
2014/30/EU Regulations 2016	Electromagnetic compatibility		EN 55015 : 2019					
2014/30/UE	Compatibilité électromagnétique		EN 61547 : 2009					
2014/30/EU	Elektromagnetische Verträglichkeit		EN 61000-3-2 : 2019					
		<u> </u>						
2014/35/EU Regulations 2016	Low voltage equipment		EN 60598-1 : 2015					
2014/35/UE	Équipements électriques à bas voltage		EN 60598-2-5 : 2015					
2014/35/EU Niederspannungsgeräte / -systeme			EN 60598-2-22 : 2014					
				EN 60529 : 1992+A2:2013				
2012/19/EU Regulations 2012	Waste of electrical and electronic equipment							
2012/19/UE	Déchets d'équipements électriques et électroniques							
2012/19/EU Entsorgung der elektrischen und			elektronischen					
	Geräte / System	ie						
2011/65/EU Regulations 2012	RoHS II Directiv	e						

On behalf of the Chalmit, I declare that, on the date the equipment accompanied by this declaration is placed on the market, the equipment conforms to all technical and regulatory requirements of the above listed directives.

En tant que représentant du fabricant Chalmit, je déclare qu'à la date où les équipements accompagnant cette déclaration sont mis sur le marché, ceux-ci sont conformes à toutes les dispositions réglementaires et techniques des directives énumérées ci-dessus.

Hiermit bestätige ich, im Namen von Chalmit, dass am Tag der Lieferung des Produkts/der Produkte zusammen mit dieser Erklärung das Gerät/die Geräte alle technischen und regulativen Anforderungen der oben aufgeführten Direktiven erfüllt.

Name and Date Nom et Date Name und Datum Mark Poutney 09/08/2021

Technical Manager Directeur technique Technischer Leiter

Quality Management System Acreditation:

Système de Management Qualité Accréditation: Qualitätsmanagementsystem Akkreditierung: Environmental Management System. Système de gestion de l'environnement. Umwelt kontroll system.

Certificate No./Certificat N°/Zertifikat Nr.

ISO 14001 by/par/durch Loyd's Register LRQ 4005876

ISO 9001