

### 1521 Style Steel Safe-T Valve Service Tee Installation Instructions

Catalog #'s 9921-99-0019-00, 9921-99-0020-00,  
9921-99-0021-00, 9921-99-0022-00, 9921-99-0026-00,  
9921-99-0027-00, 9921-99-0028-00 & 9921-99-0029-00

#### Threaded Inlet x Compression Outlet for PE Pipe

1. Verify that the compression outlet on the service tee is the correct size for the polyethylene (PE) pipe. Verify the SDR (or wall thickness) of the pipe matches the SDR (or wall thickness) stamped on the end of the stiffener.
2. Apply thread sealant to inlet threads of the tee
3. Screw the tee into the mating pipe thread.
4. Make the service connection. See other side for outlet assembly instructions.
5. To assure proper assembly and to comply with 49 CFR 192 Subpart J—Test requirements, the joint shall be leak tested.
6. Remove the pipe cap and valve stem and place in the plastic bag in which the service tee was shipped.
7. Using proper size adapters, secure control chamber of gate valve to tee.

Body Size	Adapter #
3/4" IPS	23-7317-02
1" IPS	23-7317-01
1 1/4" IPS	23-7317-00

8. For drilling operation, refer to drilling machine manufacturer's instructions and your companies qualified drilling procedures. Drilling machines such as TD-101 and TD-12 have been used with Continental Safe-T Valve Tees.
9. After the drilling operation has been completed, install the valve stem in the tee using CI pn# 23-7216-00 insertion adapter or equal. This insertion adapter has been designed to work with the TDW Speed tapper.
10. After the valve stem has been installed into the tee, remove the gate valve and size adapter.
11. Apply thread sealant and install pipe cap leak tight.

#### IMPORTANT

##### For use on:

Polyethylene (PE) gas pipe meeting the requirements of ASTM D 2513


**Pressure Rating:** Designed to meet or exceed pressure rating of PE pipe per 49 CFR Part 192 and ASTM D 2513

**Operating Temperature:** -20 to 140° F


**Material:** Carbon Steel

## Compression Outlet for PE Pipe Installation Instructions


1. Loosen the line shield nut.
2. Cut polyethylene pipe end square, deburr inside and outside, clean thoroughly to assure there is no dirt, grease, oil, etc. on assembly area of pipe.
3. Mark stab length on pipe (see examples for correct pipe or tubing size and corresponding stab length).



4. Insert the polyethylene pipe through the line shield nut until it bottoms in the outlet. (See detail "A")
5. Tighten line shield nut until it bottoms on shoulder (metal to metal). (See detail "B") The stab length line should be no more than 3/8" from face of the line shield nut.
6. If the stab length line is more than 3/8" from the face of the line shield nut, disassemble the joint and repeat steps 1 through 5.

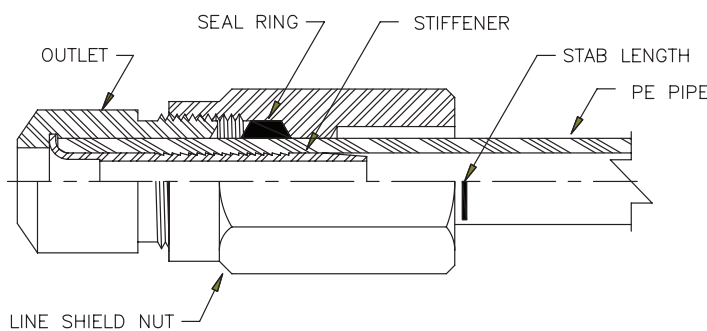

DETAIL "A"

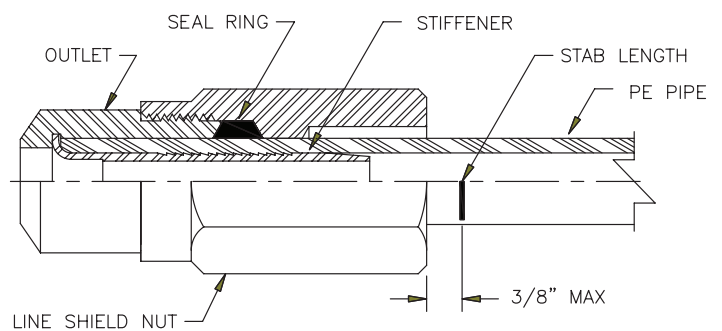

DETAIL "B"

**NOTE:** It is advisable to limit shear at main connections. In this regard, your company's policies should be followed. For further information, reference; ASTM D 2774 Standard Practice for Underground Installation of Thermoplastic Pressure Piping; Code of Federal Regulations, Title 49, Transportation Part 192; AGA Plastic Pipe Manual and/or The Guidance Manual for Operators of Small Gas Systems by the U.S. Department of Transportation.