

BRASS BASE VALVE TEE OPERATING INSTRUCTIONS

1. THREAD MALE PIPE THREAD BASE ON VALVE TEE INTO PREPARED METALLIC MAIN. THE TEE SHOULD BE THREADED INTO MAIN UNTIL SEAL HAS BEEN ESTABLISHED FOLLOWING YOUR COMPANY PROCEDURES.

NOTE: TORQUE SHOULD BE APPLIED TO METALLIC BASE TO OBTAIN LEAK FREE JOINT.

2. BY HAND, ROTATE OUTLET OF TEE TO DESIRED POSITION. THE METALLIC BASE SHOULD BE HELD IN POSITION DURING THIS OPERATION WITH A WRENCH.

3. THE SERVICE PIPING SHOULD BE CONNECTED TO THE OUTLET PER CON-STAB INSTRUCTIONS LISTED ON THE BACK OF THIS SHEET.


4. ONCE THE SERVICE HAS BEEN ESTABLISHED, PRESSURE TEST ON THE NEW INSTALLATION CAN BE APPLIED. THE PRESSURE TEST SHOULD NOT EXCEED 150 PSI.

5. TO ALLOW FLOW THRU THE SERVICE REMOVE THE PIPE CAP AND O RING. USING A 1/2" SQUARE DRIVE KEY AND TURNING COUNTER CLOCKWISE, BACK VALVE PLUG UP UNTIL IT IS FLUSH WITH TOP OF TEE. IT IS IMPORTANT THAT THE VALVE PLUG DOES NOT PROTRUDE ABOVE TEE.

6. INSPECT ORING FOR DEBRIS AND CLEAN IF NECESSARY. REPLACE ORING AND CAP AND SCREW CAP DOWN 1/4 TURN PAST HAND TIGHT.

NOTES:

1. BRASS BASE SHOULD BE PROTECTED AGAINST CORROSION. FOLLOW YOUR COMPANIES PROCEDURES.
2. IT IS ADVISABLE TO LIMIT SHEAR AT MAIN CONNECTIONS. IN THIS REGARD, YOUR COMPANY'S POLICIES SHOULD BE FOLLOWED. FOR FURTHER INFORMATION, REFERENCE; ASTM D 2774 STANDARD PRACTICE FOR UNDERGROUND INSTALLATION OF THERMOPLASTIC PRESSURE PIPING; CODE OF FEDERAL REGULATIONS, TITLE 49, TRANSPORTATION PART 192; AGA PLASTIC PIPE MANUAL AND/OR THE GUIDANCE MANUAL FOR OPERATORS OF SMALL GAS SYSTEMS BY THE U.S. DEPARTMENT OF TRANSPORTATION.
3. **DO NOT TIGHTEN THE VALVE PLUG.** THE BRASS BASE VALVE TEE IS SHIPPED WITH THE VALVE PLUG SEATED TO ALLOW A 150 PSI RESSURE TEST THROUGH THE CAP OR SERVICE WITHOUT LEAKAGE INTO THE MAIN.
4. IF THE VALVE PLUG IS USED TO SHUT OFF AN ESTABLISHED SERVICE, DO NOT EXCEED 50 FOOT-POUNDS OF TORQUE.

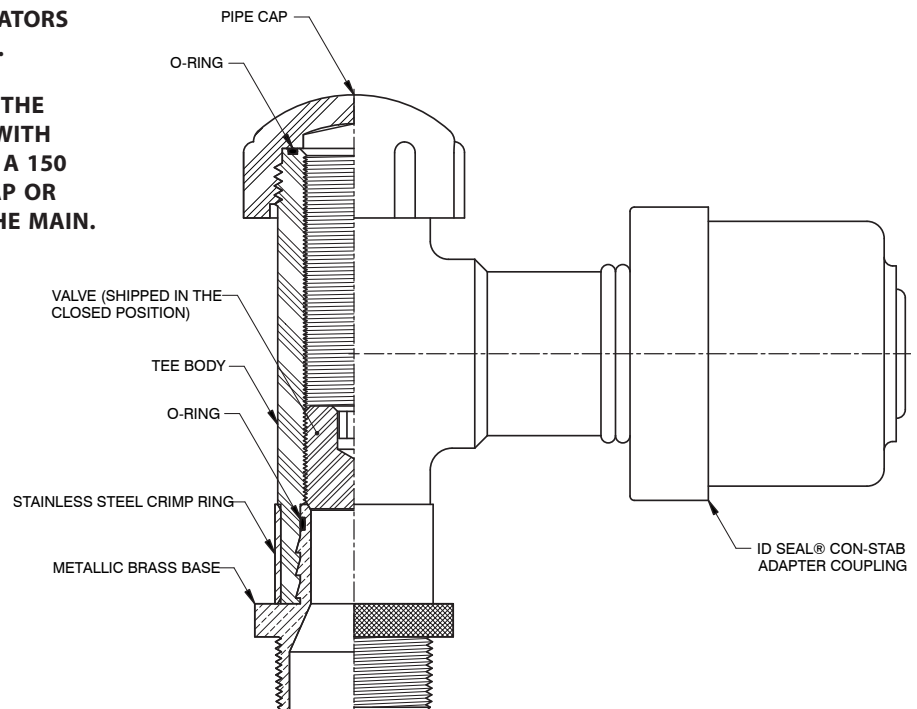

IMPORTANT

For use on:

Polyethylene gas pipe meeting the requirements of ASTM D 2513

Pressure Rating: 75 psig MAOP

Operating Temperature: -20 to 140° F

ECN 2620 REV "C" 07/23/14

ASSEMBLY INSTRUCTIONS : I.D. SEAL® CON-STAB

IMPORTANT

For use on:
Polyethylene gas pipe meeting the requirements of
ASTM D 2513

Pressure Rating: 125 psig MAOP

Operating Temperature: -20 to 140° F

1 Verify the stab fitting is the correct size for the polyethylene (P.E.) pipe. Verify the SDR (or wall thickness) of the pipe matches the SDR (or wall thickness) printed on the fitting label.



2 Cut pipe ends square.



3 Clean piping thoroughly to assure there is no dirt, grease or oil in assembly area.



4a Chamfer end of pipe using [Continental's ID chamfering tool with ID gauge](#).


or




4b Chamfer end of pipe using [Continental's double ended ID chamfering tool](#).



5 Mark the stab depth by inserting pipe into ID chamfer tool and marking the pipe at the entrance as shown.

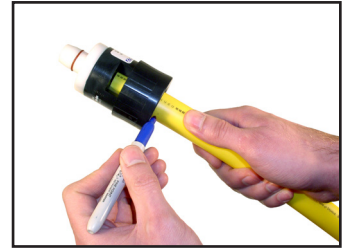

6 If using ID chamfer tool with gauge, check for proper chamfer by inserting pipe on gauge up to the o ring. With proper chamfer, o ring will begin to enter pipe.

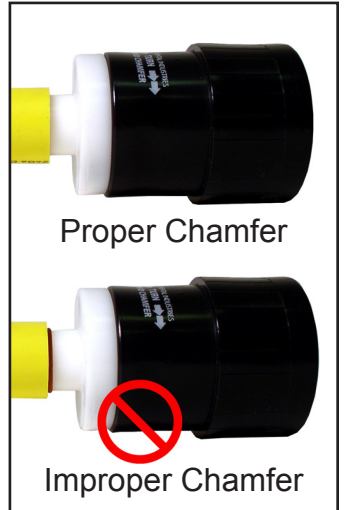

7 Stab pipe completely into fitting entrance.



8 Stab pipe completely into fitting so that the mark on the pipe is within 1/8" from the fitting entrance.



9 Repeat steps 1 thru 8 for all Con-Stab joints.

10 To assure proper assembly and to comply with 49 CFR 192 Subpart J—Test Requirements, the joint shall be leak tested.

IMPORTANT
CHAMFER THE
ID OF PIPE

