


ENCLOSURE INFORMATION		CONTACT BLOCK RATINGS:
P/N:	DESCRIPTION:	690 VAC, 20A, 50-60 60 VDC, 5A, 110VDC, 1.5A
BOX:	BOX SST IF 1a, M20 BOTTOM	1/2 HP @ 120 VAC, 1 HP @ 208/240/277VAC
COVER:	COVER SST IF 1a, SINGLE DEVICE	NEMA 4600/P600 - PILOT DUTY
MOUNT METHOD:	HKH PMBRKT	350VAC, 20A - TUNGSTEN AC690V 16A AC-12 AC230V 16A AC-15
DEVICE 1 ASSEMBLY (1F)		DC60V 5A DC-13 50-60HZ
P/N:	DESCRIPTION:	TERMINALS RATED FOR 1-2 CONDUCTORS #22-10 AWG. (0.5-4mm2)
DEVICE:	HKH2PSMTV	3 POS SEL SWT MOM LTR/RT, MAINT CTR, VERT
IGND. PLATE:	23225AAB	Blank
LOCKOUT ACQY:	NONE	N/A
CONTACT 1:	HKH1NO20P	CONTACT BLCK, FACT SEALED N.O. PM, 20A
CONTACT 2:	HKH1NO20P	CONTACT BLCK, FACT SEALED N.O. PM, 20A

CONTACT BLOCK RATINGS:
690 VAC, 20A, 50-60
60 VDC, 5A, 110VDC, 1.5A
1/2 HP @ 120 VAC, 1 HP @ 208/240/277VAC
NEMA A600/P600 - PILOT DUTY
350VAC, 20A - TUNGSTEN
AC690V 16A AC-12
AC230V 16A AC-15
50-60HZ
DC60V 5A DC-13
TERMINALS RATED FOR 1-2 CONDUCTORS
#22-10 AWG, (0.5-4mm²)

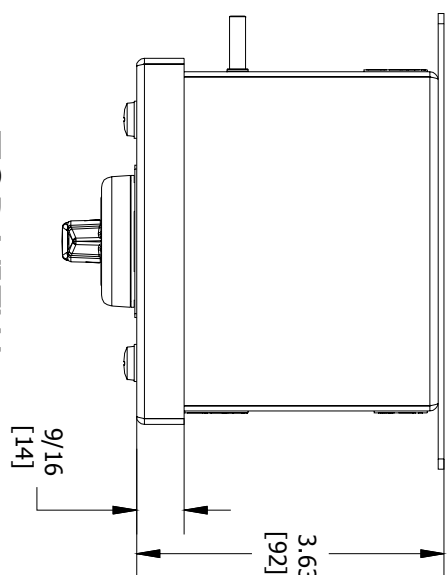

TOP VIEW

Harsco Hazardous

CAT.

HKHMOD Series

DATE CODE S/N

UL

ST. LOUIS, MO 63113

WWW.HARSHANDHAZARDOUS.COM

Harsco & Hazardous

INDUSTRIAL CONTROL EQUIPMENT FOR USE IN ZONE CLASSIFIED HAZ. LOCs.

CLASS I, ZONE 1, Aex de IIC T6...T4 Gb; Ex de IIC T6...T4 Gb

CLASS II, AEx de IIIC T85°C...T135°C Db IP66

CLASS I, DIV.2, GRPS. A,B,C,D, CLASS III, DIV.1, GRPS. E,F,G (CANADA ONLY)

CLASS II, DIV.2, GROUPS E,F,G, CLASS III

CLASS III, TYPE 3/4/4X/12/13...-50°C ≤T_{amb}≤+60°C

SEE IOM FORM K1466 FOR ELECTRICAL RATINGS.

SEE IOM FORM K1466 & K1470

FOR T-CODES AND FOR ELECTRICAL RATINGS.

ST. LOUIS, MO 63113

03539 0112G Ex de IIC T6...T4 Gb

03539 0112D Ex de IIIC T85°C...T135°C Db IP66

DEMO.13 ATEX 1405X

Ex de IIC T85°C Db IP66

IECEx TU 15.0054X

-50°C ≤T_{amb}≤+60°C

TR RU C-US, MIO62.B.04167

1EX 16.0079 1INMETRO

DATE CODE S/N

HKHMOD Series

NO.

CAT.

INDUSTRIAL CONTROL EQUIPMENT FOR USE IN ZONE CLASSIFIED HAZ. LOCs.

CLASS I, ZONE 1, Aex de IIC T6...T4 Gb; Ex de IIC T6...T4 Gb

CLASS II, AEx de IIIC T85°C...T135°C Db IP66

CLASS I, DIV.2, GRPS. A,B,C,D, CLASS III, DIV.1, GRPS. E,F,G (CANADA ONLY)

CLASS II, DIV.2, GROUPS E,F,G, CLASS III

CLASS III, TYPE 3/4/4X/12/13...-50°C ≤T_{amb}≤+60°C

SEE IOM FORM K1466 FOR ELECTRICAL RATINGS.

SEE IOM FORM K1466 & K1470

FOR T-CODES AND FOR ELECTRICAL RATINGS.

ST. LOUIS, MO 63113

03539 0112G Ex de IIC T6...T4 Gb

03539 0112D Ex de IIIC T85°C...T135°C Db IP66

DEMO.13 ATEX 1405X

Ex de IIC T85°C Db IP66

IECEx TU 15.0054X

-50°C ≤T_{amb}≤+60°C

TR RU C-US, MIO62.B.04167

1EX 16.0079 1INMETRO

DATE CODE S/N

HKHMOD Series

NO.

CAT.

INDUSTRIAL CONTROL EQUIPMENT FOR USE IN ZONE CLASSIFIED HAZ. LOCs.

CLASS I, ZONE 1, Aex de IIC T6...T4 Gb; Ex de IIC T6...T4 Gb

CLASS II, AEx de IIIC T85°C...T135°C Db IP66

CLASS I, DIV.2, GRPS. A,B,C,D, CLASS III, DIV.1, GRPS. E,F,G (CANADA ONLY)

CLASS II, DIV.2, GROUPS E,F,G, CLASS III

CLASS III, TYPE 3/4/4X/12/13...-50°C ≤T_{amb}≤+60°C

SEE IOM FORM K1466 FOR ELECTRICAL RATINGS.

SEE IOM FORM K1466 & K1470

FOR T-CODES AND FOR ELECTRICAL RATINGS.

ST. LOUIS, MO 63113

03539 0112G Ex de IIC T6...T4 Gb

03539 0112D Ex de IIIC T85°C...T135°C Db IP66

DEMO.13 ATEX 1405X

Ex de IIC T85°C Db IP66

IECEx TU 15.0054X

-50°C ≤T_{amb}≤+60°C

TR RU C-US, MIO62.B.04167

1EX 16.0079 1INMETRO

DATE CODE S/N

HKHMOD Series

NO.

CAT.

INDUSTRIAL CONTROL EQUIPMENT FOR USE IN ZONE CLASSIFIED HAZ. LOCs.

CLASS I, ZONE 1, Aex de IIC T6...T4 Gb; Ex de IIC T6...T4 Gb

CLASS II, AEx de IIIC T85°C...T135°C Db IP66

CLASS I, DIV.2, GRPS. A,B,C,D, CLASS III, DIV.1, GRPS. E,F,G (CANADA ONLY)

CLASS II, DIV.2, GROUPS E,F,G, CLASS III

CLASS III, TYPE 3/4/4X/12/13...-50°C ≤T_{amb}≤+60°C

SEE IOM FORM K1466 FOR ELECTRICAL RATINGS.

SEE IOM FORM K1466 & K1470

FOR T-CODES AND FOR ELECTRICAL RATINGS.

ST. LOUIS, MO 63113

03539 0112G Ex de IIC T6...T4 Gb

03539 0112D Ex de IIIC T85°C...T135°C Db IP66

DEMO.13 ATEX 1405X

Ex de IIC T85°C Db IP66

IECEx TU 15.0054X

-50°C ≤T_{amb}≤+60°C

TR RU C-US, MIO62.B.04167

1EX 16.0079 1INMETRO

DATE CODE S/N

HKHMOD Series

NO.

CAT.

INDUSTRIAL CONTROL EQUIPMENT FOR USE IN ZONE CLASSIFIED HAZ. LOCs.

CLASS I, ZONE 1, Aex de IIC T6...T4 Gb; Ex de IIC T6...T4 Gb

CLASS II, AEx de IIIC T85°C...T135°C Db IP66

CLASS I, DIV.2, GRPS. A,B,C,D, CLASS III, DIV.1, GRPS. E,F,G (CANADA ONLY)

CLASS II, DIV.2, GROUPS E,F,G, CLASS III

CLASS III, TYPE 3/4/4X/12/13...-50°C ≤T_{amb}≤+60°C

SEE IOM FORM K1466 FOR ELECTRICAL RATINGS.

SEE IOM FORM K1466 & K1470

FOR T-CODES AND FOR ELECTRICAL RATINGS.

ST. LOUIS, MO 63113

03539 0112G Ex de IIC T6...T4 Gb

03539 0112D Ex de IIIC T85°C...T135°C Db IP66

DEMO.13 ATEX 1405X


Ex de IIC T85°C Db IP66

IECEx TU 15.0054X


-50°C ≤T_{amb}≤+60°C

TR RU C-US, MIO62.B.04167


CERTIFICATION NAME PLATES

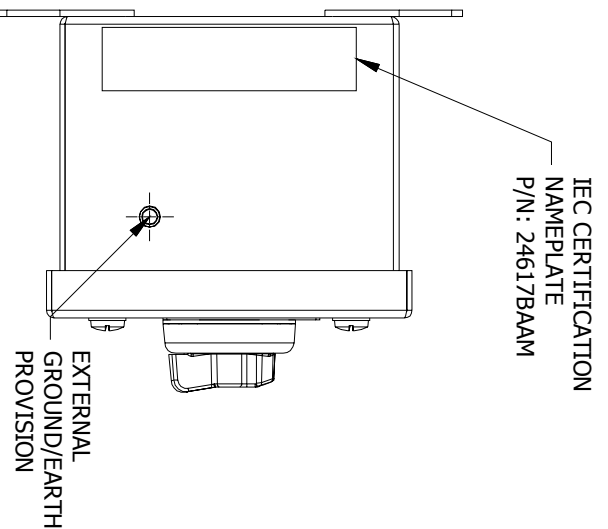


LEFT SIDE VIEW

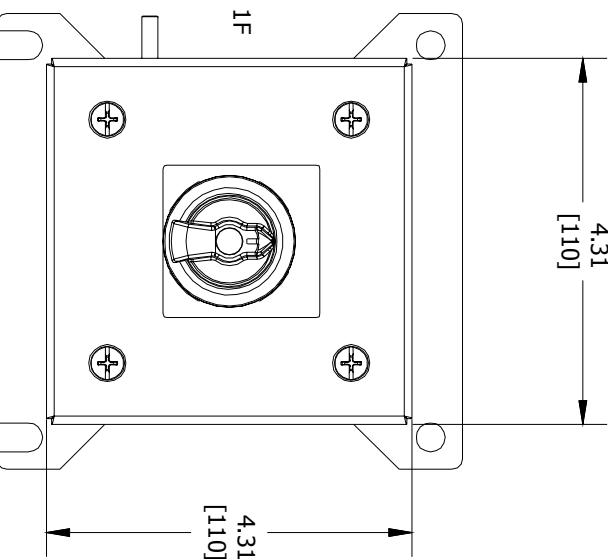


FRONT VIEW

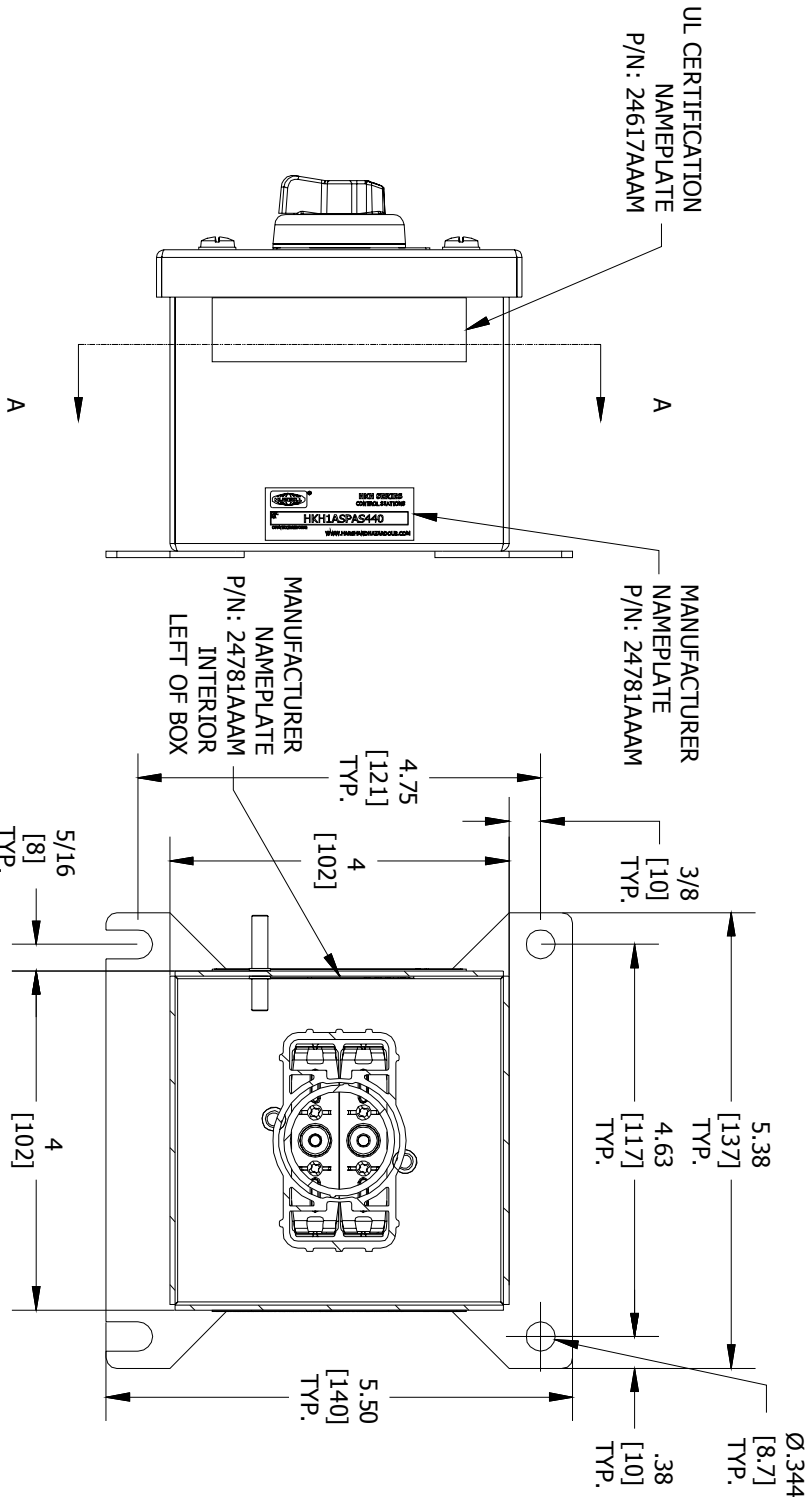

RIGHT SIDE VIEW

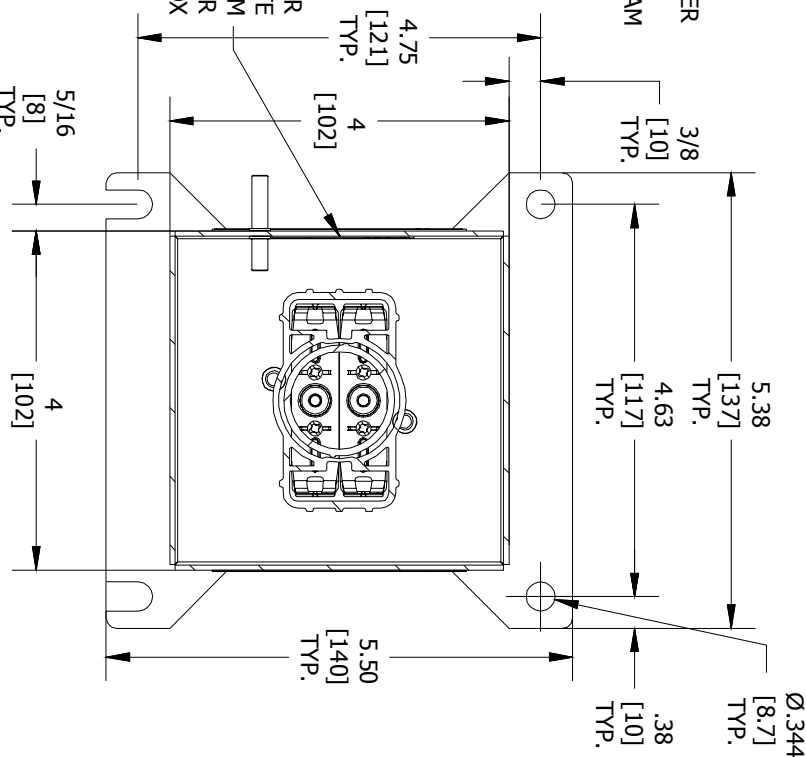

SECTION A-A VIEW

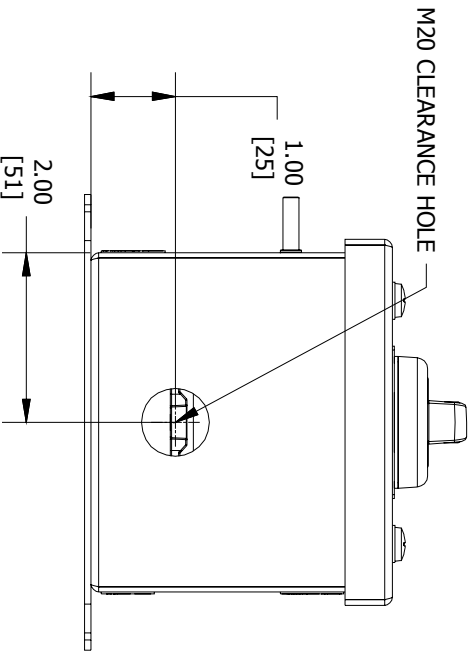

BOTTOM VIEW



HKH SERIES
CONTROL STATIONS
 PT.
 NO. HKH1ASPAS440
 COUNTRY/DATE CODE
 WWW.HARSHANDHAZARDOUS.COM

COMMENT:	SGN:	DATE:	ACCEPTANCE:		DRAWN BY:	DATE:	DWG NUMBER:	
			CODE 1: APPROVED (NO COMMENTS)				HKH1ASPAS440	
			CODE 2: APPROVED FOR MANUFACTURING WITH COMMENTS TO BE INCORPORATED		PR	09-28-2016	SALES/QUOTE NO.:	
			CODE 3: NOT APPROVED RE-SUBMIT				N/A	
			CODE 4: FOR INFORMATION ONLY		TITLE:			
					HKH MODIFIED ENCLOSURE			
REVISION		KILLARK®		THIS DOCUMENT IS THE PROPERTY OF HUBBELL - KILLARK. IT IS LOANED TO YOU AND MUST NOT BE USED IN ANY WAY DETRIMENTAL TO THE INTEREST HUBBELL - KILLARK.				
				(HKH1ASPAS440)				
				SHEET 1 OF 1				

THIS DOCUMENT IS THE PROPERTY OF HUBBELL - KILLARK.
IT IS LOANED TO YOU AND MUST NOT BE USED IN ANY WAY
DETRIMENTAL TO THE INTEREST HUBBELL - KILLARK.