M-9561 | 4

CATALOG NUMBER MS(L/M)1****O SHOWN

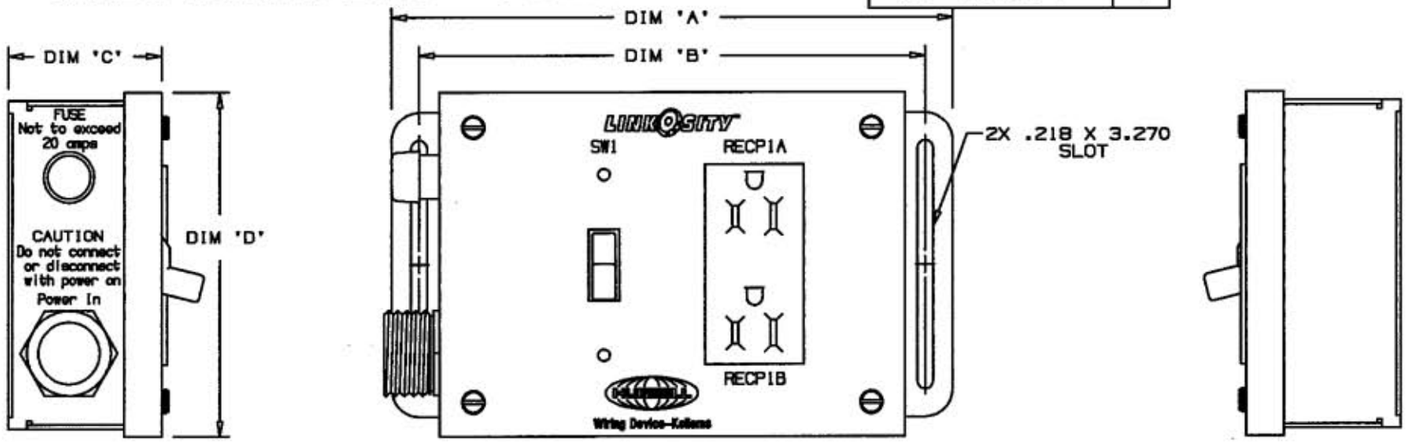

CAT. NUMBER [1]	RECEPTACLES	DIMENSION 'A'	DIMENSION 'B'	DIMENSION 'C'	DIMENSION 'D'
MS(L/M)1****0	1	7.50 [190.5]	6.75 [171.5]	2.25 [57.2]	4.53 [115.1]
MS(L/M)2****0	2	9.50 [241.3]	8.75 [222.3]	2.25 [57.2]	4.53 [115.1]
MS(L/M)3****0	3	11.50 [292.1]	10.75 [273.1]	2.25 [57.2]	4.53 [115.1]
MS(L/M)4****0	4	13.50 [342.9]	12.75 [323.9]	2.25 [57.2]	4.53 [115.1]
MS(L/M)5****0	5	15.50 [393.7]	14.75 [374.7]	2.25 [57.2]	4.53 [115.1]

CATALOG NUMBER

M S* * ** ** 0

- CONSTANT VALUE "M" [1]
- SWITCH TYPE [2]
- NUMBER OF RECEPTACLES
- RECEPTACLE TYPE [3]
- RECEPTACLE FEATURE [4]
- PASS-THRU

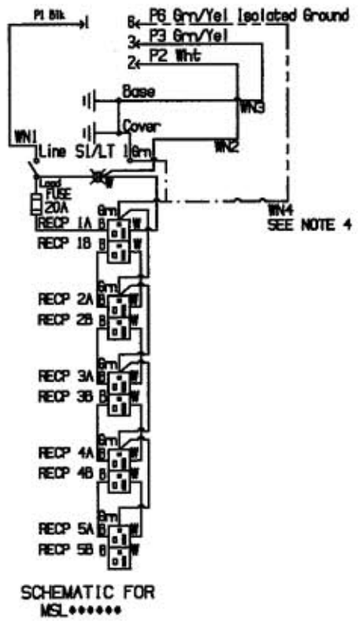

SCHEMATIC FOR MSL******

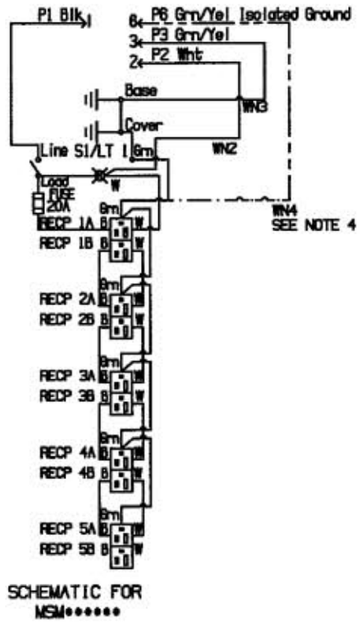

SCHEMATIC FOR MSM******

NOTES:

1. DIMENSIONS ARE IN INCHES & [MM].
2. ALL DEVICES ARE UL LISTED.
3. ENCLOSURES RATING: TYPE 1.
4. DEVICES WITH ISOLATED GROUND RECEPTACLES HAVE INSULATED CONTINUOUS CONDUCTOR TO RECEPTACLE ISOLATED GROUND TERMINAL ORIGINATING FROM WN4, OTHERWISE A CONTINUOUS CONDUCTOR TO GROUND TERMINALS ORIGNATE FROM WN3 .
5. LINKOSITY™ IS A TRADEMARK OF LOCKHEED MARTIN.

[6] DO NOT USE GFCI RECEPTACLES WITH LED'S & GFCI RECEPTACLES WITHOUT LED'S IN THE SAME PSDA.

[2] Switch Type		Pass-Thru	
SL = Local On/Off	HBL1221PL	O	NO PASS-THRU
SM = Master On/Off	HBL1221PL	P	PASS-THRU

4 Receptacle Feature	[3] Receptacle Type: CR Corrosion Resistant	HG Hospital Grade	SG Specification Grade	L1 NEMA L5-15R Twist Lock	L2 NEMA L5-20R Twist Lock
00 Standard	HBL53CM62	HBL8300GY	CR5362GY	HBL4700	HBL2310
IG Isolated Ground	N/A	IG8300GY	CR5362IGGY	IG4700A	IG2310
GF Ground Fault	N/A	GF8300GYA	[6] GFR5352GYL or GF20GYL	N/A	N/A
SI Surge Suppression Isolated Ground	N/A	IG8362GYSA	IG5352GYSA	N/A	N/A
SS Surge Suppression	N/A	HBL8362GYSA	HBL5362GYSA	N/A	N/A

LIST OF PARTS

DESCRIPTION	MATERIAL	FINISH

SYM	REVISIONS	APP	DATE
4	GFR5352GYL, WAS "GFR5352GYA" ADD "OR GF20GYL" ADD NOTE 6, "DO NOT USE GFCI RECEPTACLES WITH LED'S & GFCI RECEPTACLES WITHOUT LED'S IN THE SAME PSDA." DCN 13548 GPK CH	CH	1/8/07
3	4/6/06 ADDED "PASS-THRU" TABLE; IN "RECEPTACLE TYPE" TABLE; "L1" WAS "15" & "L2" WAS "20" PER DCN 13020 RCM JPP	JPP	4/6/06
2	ADDED "CAUTION..." PAD PRINTING. REMOVED "PL1" FROM "POWER IN" PRINTING. "FUSE" PRINTING WAS "FU1". RELOCATED "FUSE..." PRINTING ABOVE THE FUSE. REMOVED "PL1" FROM SCHEMATICS. "FUSE" WAS "FU1" ON SCHEM. "WN4 SEE NOTE 4" WAS "WN4". CAT. NO. "GFR5352GYA" WAS "CR5352GYA" PER DCN # 12890	WRV	10/28/05
1	RELEASED PER DCN 12049. MYA	RDK	10/09/04

THE DESIGN AND DIMENSIONS OF THE PRODUCT SHOWN ON THIS DRAWING ARE SUBJECT TO CHANGE WITHOUT NOTICE

TITLE

20A PSDA W/SWITCH

TOLERANCES UNLESS OTHERWISE SPECIFIED
~~FRACTIONS ± 1/64~~
~~DECIMALS ± .005~~
~~ANGLES ± 2°~~

WIRING DEVICE-KELLEMS
HUBBELL INCORPORATED
BRIDGEPORT, CT

DR. BY MYA | APP. BY RDK
TR. BY | SCALE NONE
CHK'D BY RDK | DATE 10/19/04

CODE 74545

DIMENSION SHEET FOR CAT. NO.

REPAIRABLE ☒ NON-REPAIRABLE ☐

B

M-9561

4