RTS-H SFRIFS	Cat.#		HUBBELL	HUBBELL	
DUI EC	Job	Туре		Outdoor Lighting	
I ULLO			Approvals		
ROUND TAPERED STEEL					

APPLICATIONS

Lighting installations for side and top mounting of luminaires with effective projected area (EPA) not exceeding maximum allowable loading of the specified pole in its installed geographic location

CONSTRUCTION

SHAFT: One-piece tapered steel with round cross section, Minimum yield of 55,000 psi; Steel base plate with axial bolt circle slots welded flush to pole shaft having minimum yield of 36,000 psi (ASTM A36) Pole shafts taper at .14"/ft.

GROUP 1

- ANCHOR BOLTS: Supplied with (4) galvanized anchor bolts with minimum yield of 55,000 psi (ASTM F1554). Galvanized hardware with two washers and two nuts per bolt for leveling
- BOLT COVERS: Individual anchor bolt nut covers provided as standard
- BASE COVER: Optional two-piece square base cover available
- POLE CAP: Pole shaft supplied with removable cover when applicable; Tenon and post-top configurations also available
- HANDHOLE: 4" X 6.5" handhole opening with cover and grounding provision. The handhole is located 18" from the base of the pole.

GROUP 2

Overall Height

10' - 50'

Handhole


- ANCHOR BOLTS: Supplied with (3) galvanized anchor bolts with minimum yield of 55,000 psi (ASTM F1554). Galvanized hardware with two washers and two nuts per bolt for leveling. Top nut is acorn nut.
- POLE CAP: 3" pole top standard; Supplied with removable cover when applicable; Tenon configurations also available
- HANDHOLE: 3" X 5" handhole opening with cover and grounding provision. The handhole is located 18" from the base of the pole.

GROUP 3

- ANCHOR BOLTS: Supplied with (4) galvanized anchor bolts with minimum yield of 55,000 psi (ASTM F1554). Galvanized hardware with two washers and two nuts per bolt for leveling
- BASE COVER: Two-piece square base cover supplied as standard.
- POLE CAP: Pole shaft supplied with removable cover when applicable; Tenon and post-top configurations also available
- HANDHOLE: 4" X 6.5" handhole opening with cover and grounding provision. The handhole is located 18" from the base of the pole.

FINISH

- Durable thermoset polyester powder coat paint finish with nominal 3.0 mil thickness
- Powder paint prime applied over "white metal" steel substrate cleaned via mechanical shot blast method

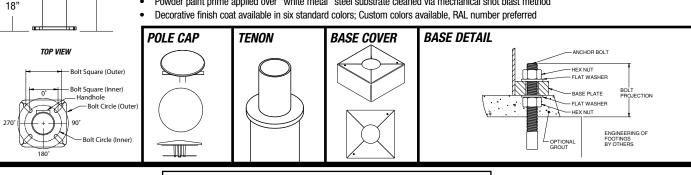

ORDERING INFORMATION Reference page 2 for available configurations ORDERING EXAMPLE: 65 -**S2** SBC RTS - H 20 Α 2 DB **THICKNESS FINISH SERIES** HEIGHT SHAFT MOUNTING **OPTIONS** 20 Amp GFCI Recep-RTS-H Reference 1 Single arm mount **BLT** Black Matte Textured Round Tapered Reference page 2 Bottom O.D. GFI¹ Reference page 2 Steel Pole Ordering matrix page 2 tacle and Cover **BLS** Black Gloss Smooth Two fixtures at 180° Ordering matrix Hubbell Outdoor Ordering matrix Extra Handhole EHH1 **DBT** Dark Bronze Matte Textured Two fixtures at 90° .5" Coupling **DBS** Dark Bronze Gloss Smooth C051 3T Three fixtures at 90° **GTT** Graphite Matte Textured C071 .75" Coupling

37

TΑ

TB

TC

MOL	JNTING C	RIENTATION	O Denotes handhole location
1	2	2L 3T	3Y 4

1 Specify option location using logic found on page 2 (Option Orientation)

ACCESSORIES - Order Senarately

710020071120 011	ao. coparatory
Catalog Number	Description
VM2SXX	2nd mode vibration damper

DRILL PATTERN

WHT

Color Option

CC Custom Color

Light Grey Gloss Smooth

Platinum Silver Smooth

White Matte Textured

White Gloss Smooth

VGT Verde Green Textured

B1 Cruzer, "AM" arm

Three fixtures at

Four fixtures at 90°

Tenon (2.375" OD)

Tenon (2.875" OD)

Open Top (includes

Tenon (3.5" OD)

pole cap)

120

- B3 2 bolt (2-1/2" spacing), Viper "A" arm
- S2 2 bolt (3-1/2" spacing), Viper "AD" arm



C201 2" Coupling

Bracket

dampei

Cover

MPB¹

LAB

SBC

Mid-pole Luminaire

2nd mode vibration

Less Anchor Bolts


Square Base



ORDERING INFORMATION Cont.


Catalog Number	He	ight	Nominal	Wall	Wall Bolt Circle		Base Blote Causes	Anchor bolt size	Dall Davidski	Pole	
Catalog Number	Feet Meters Shaft Dimensions Thickness (suggested)	Base Plate Square	Anchor boil size	Bolt Projection	weight						
Group 1											
RTS-H-20-65-A	20	6.1	6.5" x 3.7"	.119"	10"	9.5" - 13.0"	12.5" - Square	1" x 36" x 4"	4.25"	187	
RTS-H-25-70-A	25	7.6	7.0" x 3.5"	.119"	10"	10" - 13.0"	12.5" - Square	1" x 36" x 4"	4.25"	226	
RTS-H-30-80-A	30	9.1	8.0" x 3.8"	.119"	11"	11" - 13.5"	12.5" - Square	1" x 36" x 4"	4.25"	290	
RTS-H-35-85-A	35	10.7	8.5" x 3.6"	.119"	13"	11.5" - 13.5"	12.5" - Square	1" x 36" x 4"	4.25"	340	
RTS-H-39-90-A	39	11.9	9.0" x 3.5"	.119"	13"	12.5' - 13.5"	12.5" - Square	1" x 36" x 4"	4.25"	382	
					Group 2						
RTS-H-10-50-A	10	3.0	4.4" x 3.0"	.119"	8"	8"	8.5" - Triangular	3/4" x 17" x 3"	3.5"	60	
RTS-H-12-50-A	12	3.7	4.7" x 3.0"	.119"	8"	8"	8.5" - Triangular	3/4" x 17" x 3"	3.5"	70	
RTS-H-14-50-A	14	4.3	5.0" x 3.0"	.119"	8"	8"	8.5" - Triangular	3/4" x 17" x 3"	3.5"	80	
RTS-H-16-50-A	16	4.9	5.2" x 3.0"	.119"	8"	8"	8.5" - Triangular	3/4" x 17" x 3"	3.5"	95	
RTS-H-18-50-A	18	5.5	5.5" x 3.0"	.119"	8"	8"	8.5" - Triangular	3/4" x 17" x 3"	3.5"	110	
RTS-H-20-60-A	20	6.1	5.8" x 3.0"	.119"	8"	8"	8.5" - Triangular	3/4" x 17" x 3"	3.5"	125	
					Group 3						
RTS-H-25-70-B	25	7.6	7.0" x 3.5"	.179"	10.0"	9.5 - 10.5"	10.88" - Square	1" x 36" x 4"	4.25"	280	
RTS-H-30-80-B	30	9.1	8.0" x 3.8"	.179"	11.0"	10.5 - 11.5"	11.5" - Square	1.25" x 42" x 6"	5.0"	380	
RTS-H-35-95-A	35	10.7	9.5" x 4.6"	.119"	13.0"	12.5 - 13.5"	13.0" - Square	1" x 36" x 4"	4.25"	370	
RTS-H-40-90-A	40	12.2	9.0" x 3.6"	.119"	12.5"	12 - 13.0"	12.38" - Square	1" x 36" x 4"	4.25"	355	
RTS-H-40-90-B	40	12.2	9.0" x 3.6"	.179"	12.5"	12 - 13.0"	12.38" - Square	1.25" x 42" x 6"	5.0"	515	
RTS-H-45-10-A	45	13.7	10.0" x 3.7"	.119"	13.5"	13 - 14.0"	14.0" - Square	1" x 36" x 4"	4.25"	450	
RTS-H-50-10-A	50	15.2	10.0" x 3.0"	.119"	13.5"	13 - 14.0"	14.0" - Square	1" x 36" x 4"	4.25"	475	
RTS-H-50-10-B	50	15.2	10.0" x 3.0"	.179"	13.5"	13 - 14.0"	14.0" - Square	1.25" x 42" x 6"	5.0"	680	

NOTE Factory supplied template must be used when setting anchor bolts. Hubbell Lighting will deny any claim for incorrect anchorage placement resulting from failure to use factory supplied template and anchor bolts.

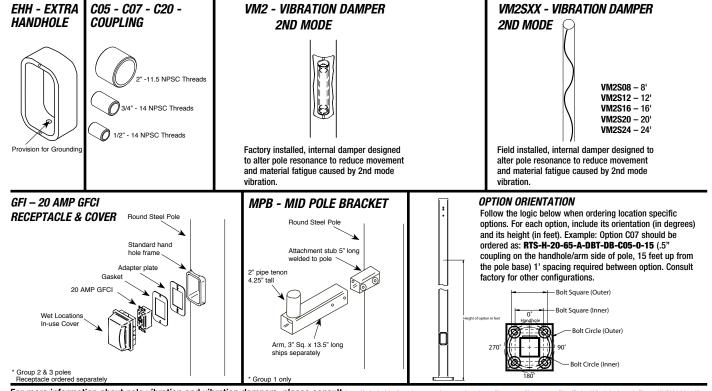

For more information about pole vibration and vibration dampers, please consult http://cdn.hubbelloutdoor.com/content/products/literature/literature_files/Pole_Wind_Induced_Flyer_HL010022.pdf Due to our continued efforts to improve our products, product specifications are subject to change without notice.



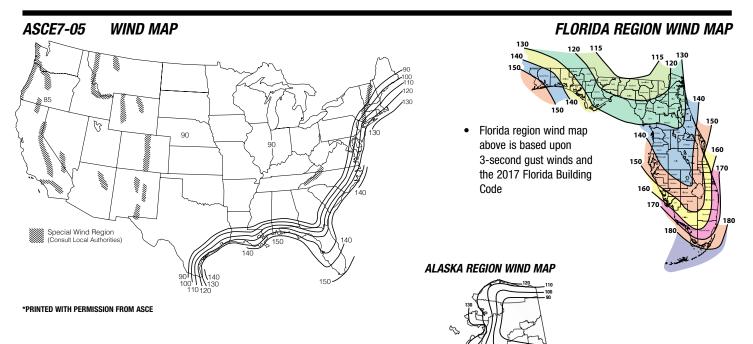

HAWAII - 105 mph PUERTO RICO - 145 mph

ASCE 7-05 wind map EPA Load Rating - 3 second gust wind speeds										
Catalog Number	Height	85	90	100	110	120	130	140	150	
RTS-H-20-65-A	20	23.1	21.5	17.4	14.4	10.0	8.3	7.0	6.0	
RTS-H-25-70-A	25	21.2	17.9	14.5	11.8	7.5	6.0	5.1	4.3	
RTS-H-30-80-A	30	19.5	15.2	12.1	9.8	7.1	5.8	4.8	3.9	
RTS-H-35-85-A	35	14.9	12.7	10.0	8.7	5.3	4.2	3.3	2.6	
RTS-H-39-90-A	39	13.4	10.6	8.3	6.5	4.5	3.3	2.4	1.8	
RTS-H-10-50-A	10	22.0	21.5	17.4	14.4	12	10.1	8.7	7.5	
RTS-H-12-50-A	12	18.8	17.9	14.5	11.8	9.8	8.2	7	6	
RTS-H-14-50-A	14	17.7	15.2	12.1	9.8	8.1	6.7	5.6	4.8	
RTS-H-16-50-A	16	16.5	12.7	10	8	6.5	5.4	4.5	3.8	
RTS-H-18-50-A	18	14.0	10.6	8.3	6.5	5.2	4.2	3.5	2.9	
RTS-H-20-60-A	20	12.1	8.9	6.8	5.3	4.1	3.3	2.6	2.2	
RTS-H-25-70-B	25	25.0	22.6	18.1	14.7	12.2	10.3	8.8	7.6	
RTS-H-30-80-B	30	25.0	25.0	25.0	21.6	18.1	15.4	13.2	11.4	
RTS-H-35-95-A	35	20.0	17.7	14.1	11.5	9.4	7.8	6.5	5.4	
RTS-H-40-90-A	40	15.5	13.6	10.6	8.3	6.7	5.4	4.4	3.6	
RTS-H-40-90-B	40	25.0	25.0	20.2	16.5	13.7	11.4	9.7	8.2	
RTS-H-45-10-A	45	12.4	10.8	8.1	6.1	4.8	3.7	2.9	2.1	
RTS-H-50-10-A	50	9.5	8.2	5.8	4.2	2.9	2.0	1.2	0.7	
RTS-H-50-10-B	50	19.2	17.4	13.6	10.7	8.5	6.9	5.5	4.4	

Florida Building Code 2017 EPA Load Rating - 3 second gust wind speeds											
Catalog Number	115	120	130	140	150	160	170	180			
RTS-H-20-65-A	25.0	25.0	25.0	21.5	18.3	15.7	13.6	11.9			
RTS-H-25-70-A	25.0	23.0	19.2	16.1	13.6	11.5	9.8	8.4			
RTS-H-30-80-A	21.1	19.0	15.5	12.8	10.6	8.8	7.3	6.0			
RTS-H-35-85-A	17.1	15.3	12.3	9.9	8.0	6.4	5.1	1.0			
RTS-H-39-90-A	15.4	13.7	10.8	8.6	6.7	5.2	4.0	3.0			
RTS-H-10-50-A	21.8	20.2	17.2	14.7	12.7	11.2	9.7	8.7			
RTS-H-12-50-A	17.4	16.7	14.2	12.2	10.5	9.0	8.0	7.0			
RTS-H-14-50-A	15.0	14.2	12.0	10.0	8.7	7.5	6.5	5.7			
RTS-H-16-50-A	12.2	11.7	9.7	8.2	7.0	6.0	5.2	4.5			
RTS-H-18-50-A	11.1	9.7	8.0	6.7	5.5	4.7	4.0	3.5			
RTS-H-20-60-A	9.2	8.2	6.7	5.5	4.5	3.7	3.0	2.5			
RTS-H-25-70-B	25.0	21.1	17.8	15.2	13.1	11.4	10	8.9			
RTS-H-30-80-B	25.0	30.2	25.7	22.2	19.4	17	15	13.4			
RTS-H-35-95-A	20.0	16.5	13.9	11.8	10.1	8.7	7.6	6.5			
RTS-H-40-90-A	15.5	12.6	10.4	8.6	7.3	6.1	5.2	4.5			
RTS-H-40-90-B	25.0	23.5	19.9	17	14.6	12.7	11.1	9.8			
RTS-H-45-10-A	12.4	9.9	8	6.5	5.3	4.3	3.5	2.9			
RTS-H-50-10-A	9.5	7.4	5.7	4.4	3.3	2.4	1.8	1.2			
RTS-H-50-10-B	19.2	16.1	13.3	11.1	9.3	7.8	6.6	5.6			

- Allowable EPA, to determine max pole loading weight, multiply allowable EPA by 30 lbs.
- The tables for allowable pole EPA are based on the ASCE 7-05 Wind Map or the Florida Region Wind Map for the 2017 Florida Building Code. The Wind Maps are intended only as a general guide and cannot be used in conjunction with other maps. Always consult local authorities to determine maximum wind velocities, gusting and unique wind conditions for each specific application
- Allowable pole EPA for jobsite wind conditions must be equal to or greater than the total EPA for fixtures, arms, and accessories to be assembled to the pole. Responsibility lies with the specifier for correct pole selection. Installation of poles without luminaires or attachment of any unauthorized accessories to poles is discouraged and shall void the manufacturer's warranty
- Wind speeds and listed EPAs are for ground mounted installations. Poles mounted on structures (such as bridges and buildings) must consider vibration and coefficient of height factors beyond this general guide; Consult local and federal standards
- Wind Induced Vibration brought on by steady, unidirectional winds and other unpredictable aerodynamic forces are not included in wind velocity ratings. Consult Hubbell Lighting's Pole Vibration Application Guide for environmental risk factors and design considerations. http://cdn.hubbelloutdoor.com/content/products/literature_files/Pole_Wind_Induced_Fiyer_HL0I0022.pdf
- Extreme Wind Events like, Hurricanes, Typhoons, Cyclones, or Tornadoes may expose poles to flying debris, wind shear or other detrimental effects not included in wind velocity ratings

Due to our continued efforts to improve our products, product specifications are subject to change without notice.



