
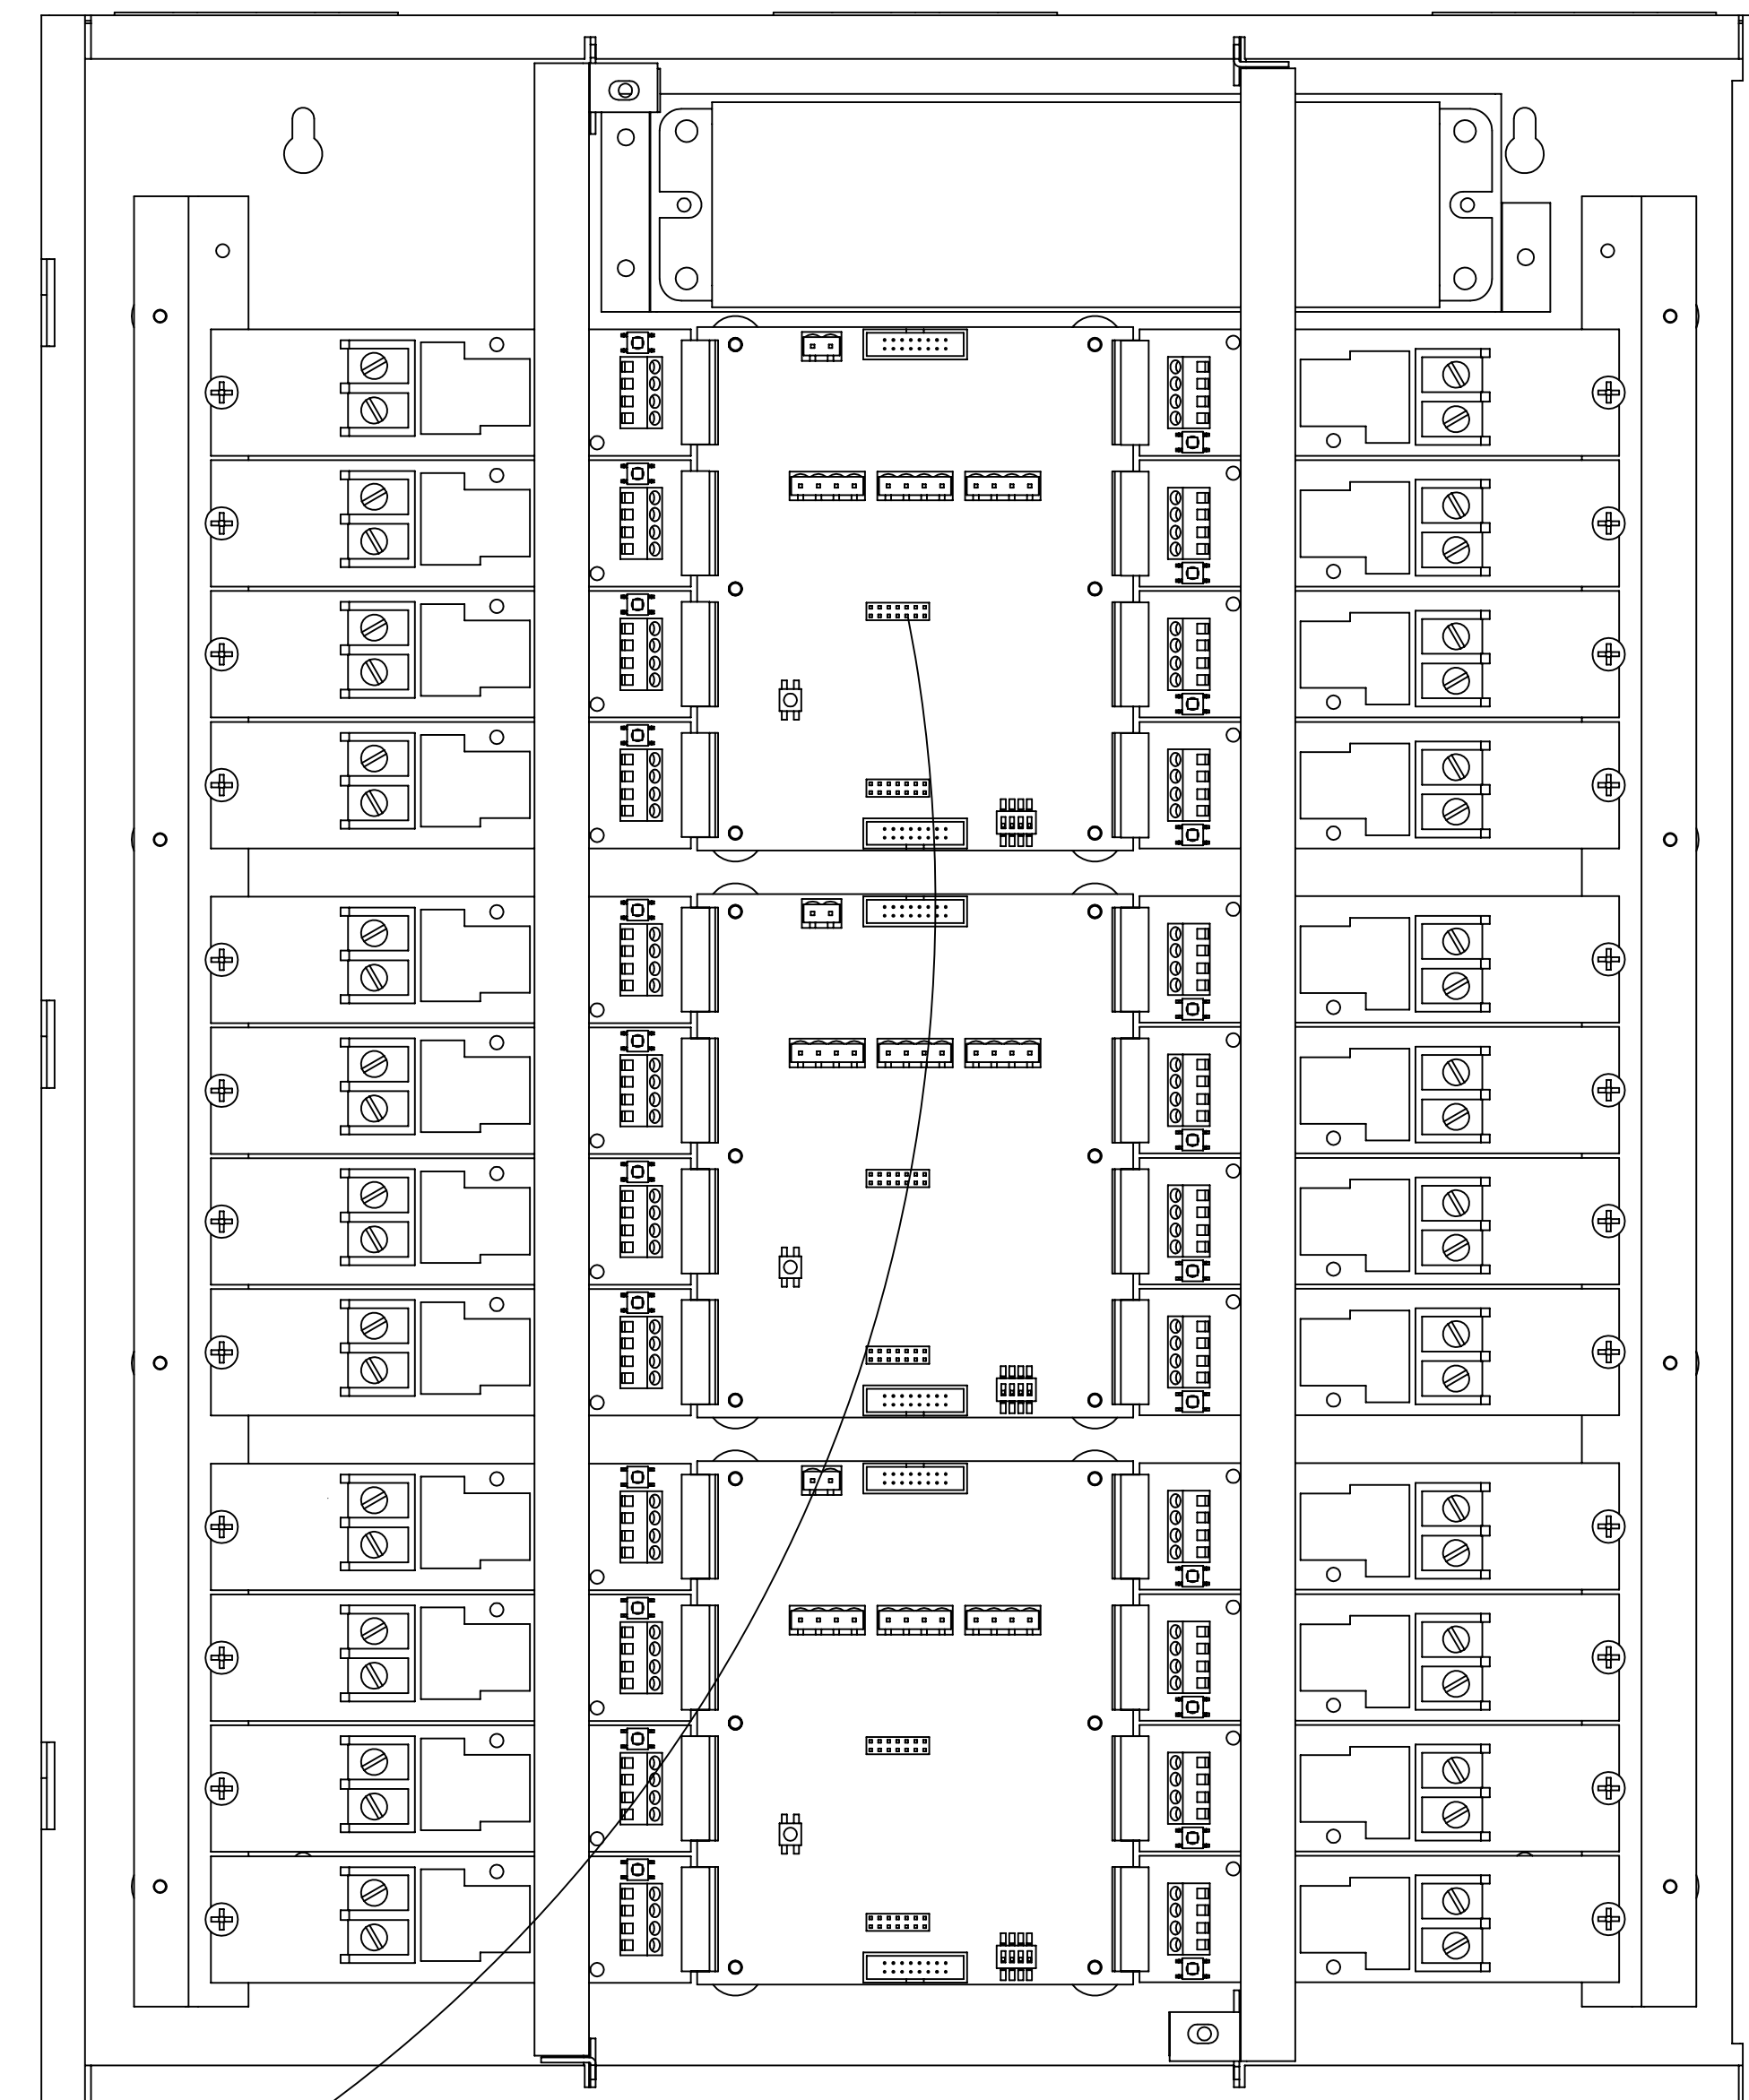


# Master/Secondary

## Master Panel

## Secondary Panel

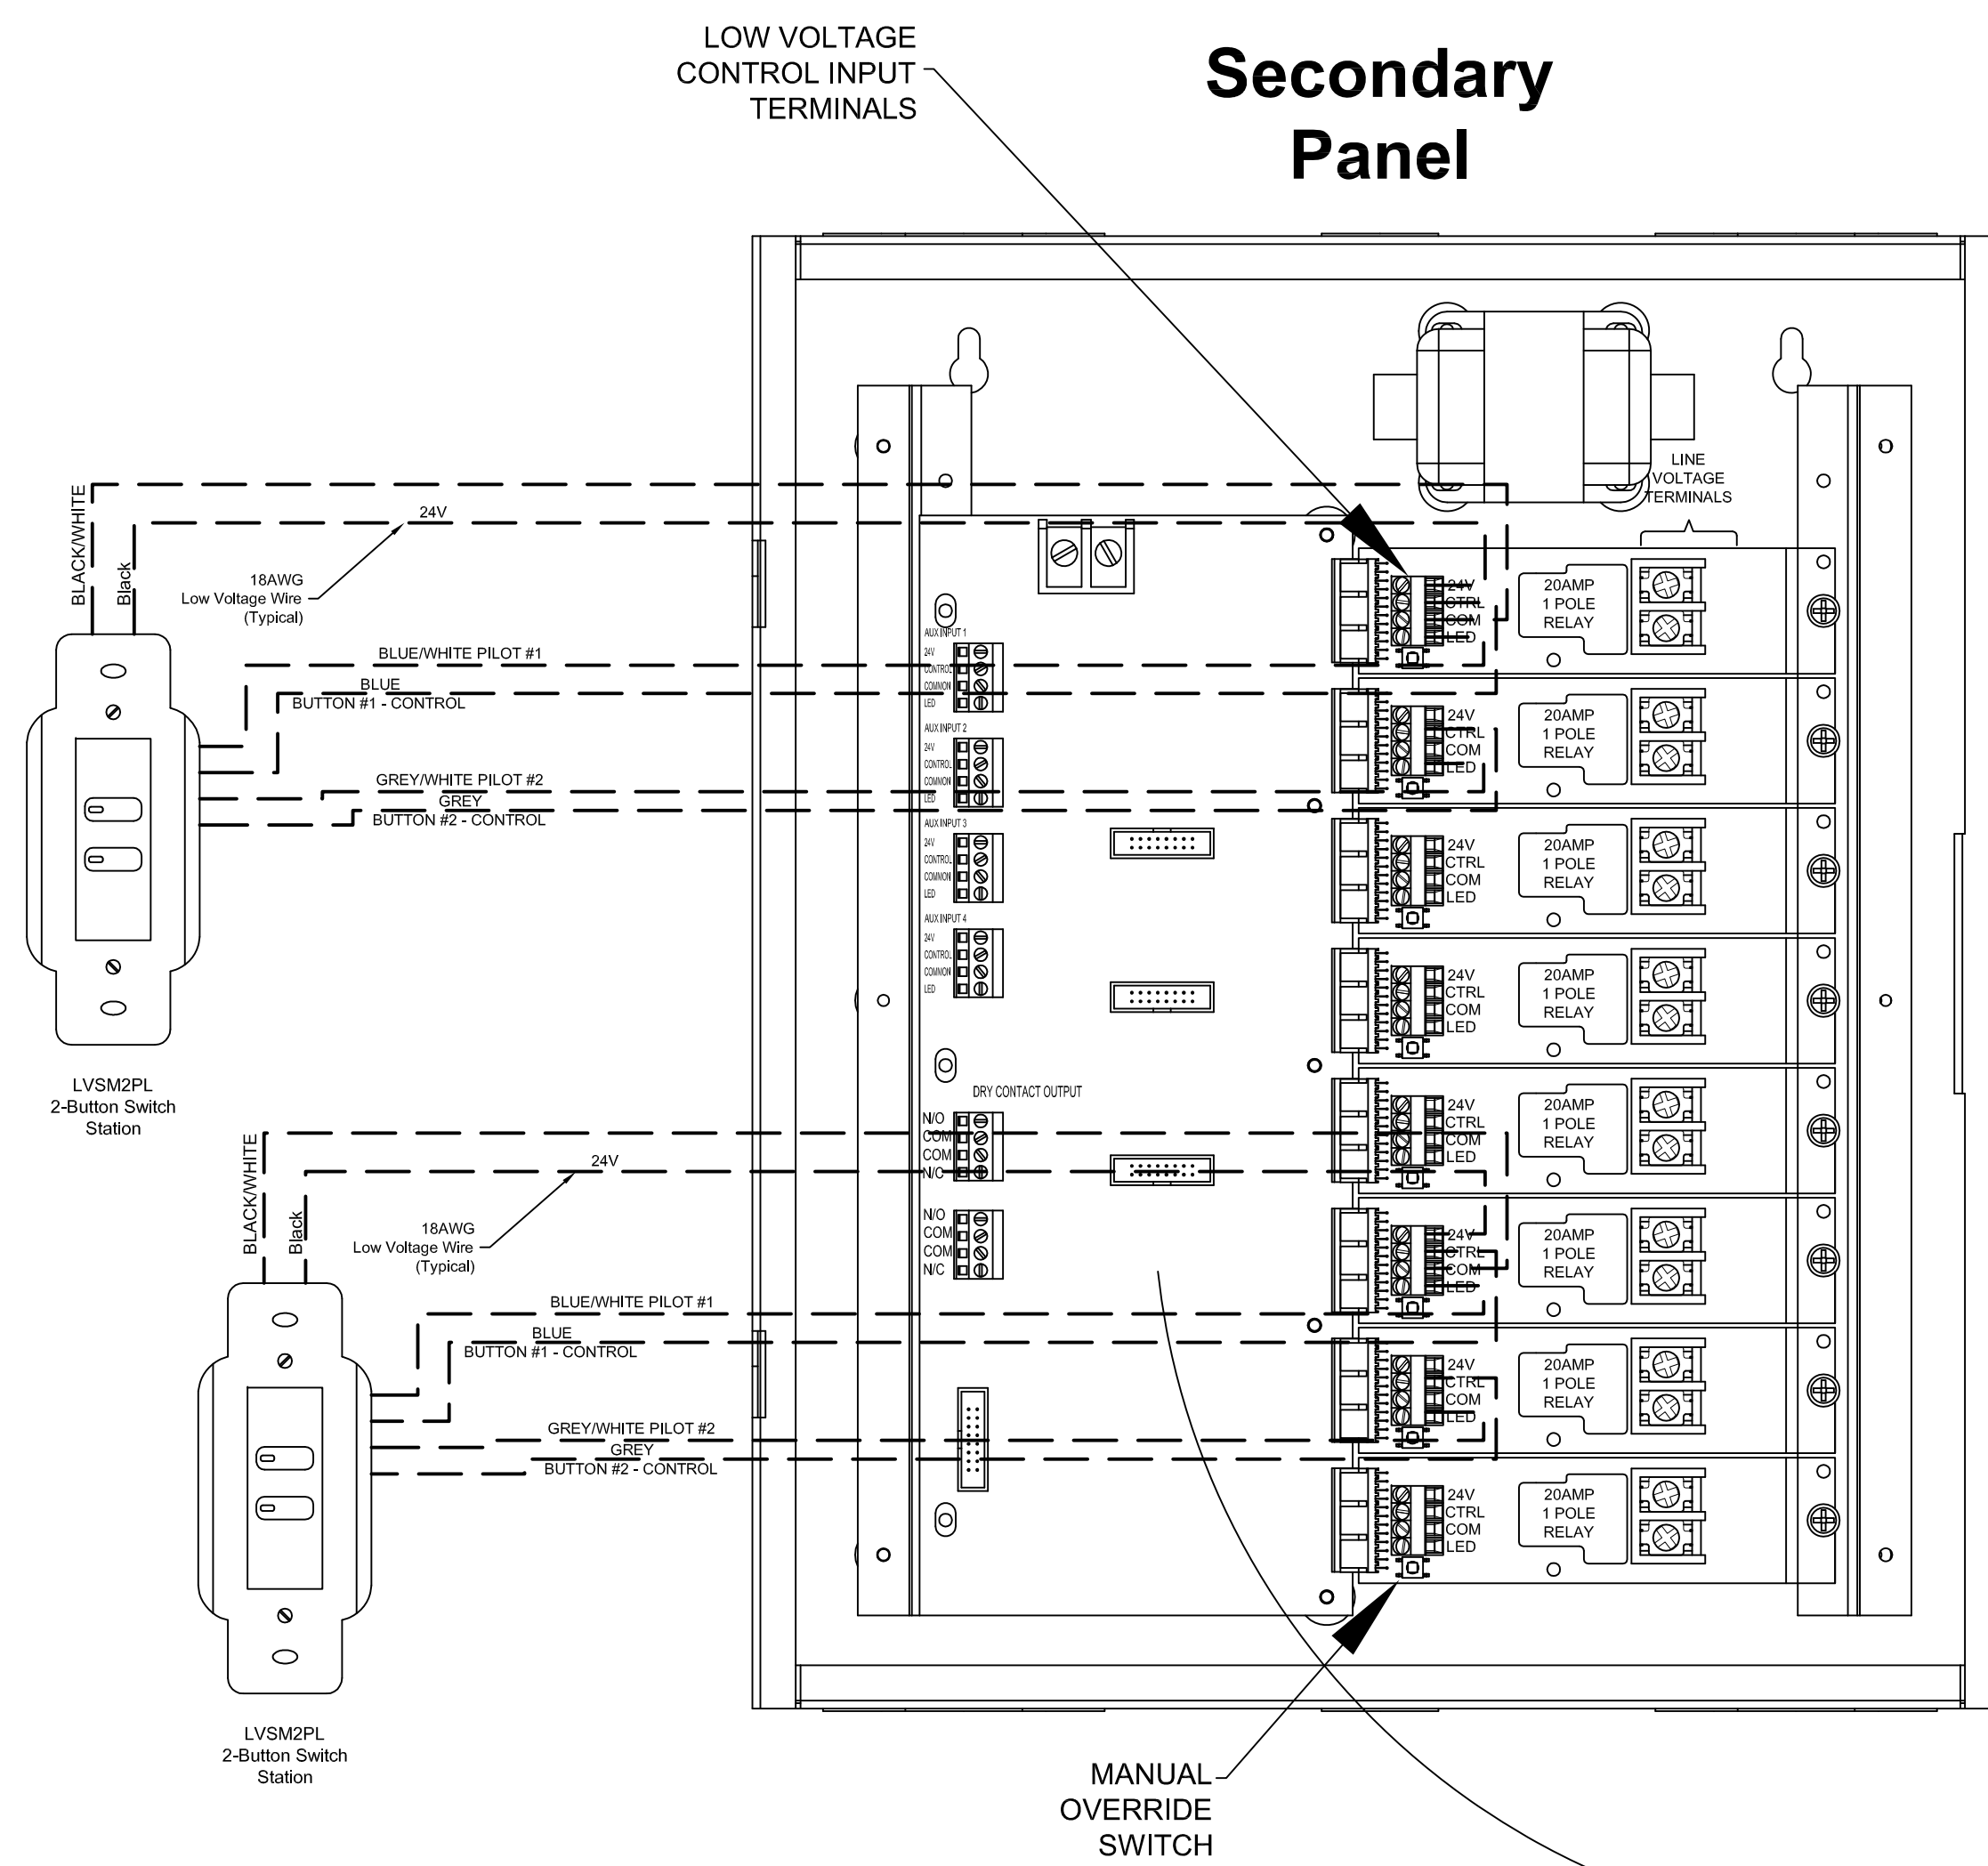

Interconnection Cable, use  
CAT5 or CAT5e cable,  
750feet MAXIMUM length

**NOTES:**

1. Interconnection Cable, use CAT5 or CAT5e cable, 750 feet MAXIMUM length.
2. Only 2 CX Panels can be interconnected together.
3. Caution: ALWAYS remove supply power to the Panel control Transformer prior to making any connections between relay boards and panel processor board. Failure to do so may result in personnel injury, damage to the panel, and void its warranty.
4. WARNING: Failure to install cards in the proper panel and correct orientation can damage panels and VOID Equipment WARRANTY.

2 CX Panels Interconnected

9601 Dessau Road Building One  
Austin, Texas 78745  
Hubbell-Automation.com

Building Automation, Inc.



CX  
1